



**SIL Certified Large Electric Sonic Valve (LESV)**  
**Gas Fuel Control Valve**

**2-inch, 3-inch, 4-inch, 6-inch**

**Installation and Operation Manual**



### General Precautions

Read this entire manual and all other publications pertaining to the work to be performed before installing, operating, or servicing this equipment.

Practice all plant and safety instructions and precautions.

Failure to follow instructions can cause personal injury and/or property damage.



### Revisions

This publication may have been revised or updated since this copy was produced. The latest version of most publications is available on the Woodward website.

[Woodward Industrial Support: Get Help](#)

If your publication is not there, please contact your customer service representative to get the latest copy.



### Proper Use

Any unauthorized modifications to or use of this equipment outside its specified mechanical, electrical, or other operating limits may cause personal injury and/or property damage, including damage to the equipment. Any such unauthorized modifications: (i) constitute "misuse" and/or "negligence" within the meaning of the product warranty thereby excluding warranty coverage for any resulting damage, and (ii) invalidate product certifications or listings.



### Translated Publications

If the cover of this publication states "Translation of the Original Instructions" please note:

The original source of this publication may have been updated since this translation was made. The latest version of most publications is available on the Woodward website.

[Woodward Industrial Support: Get Help](#)

Always compare with the original for technical specifications and for proper and safe installation and operation procedures.

If your publication is not on the Woodward website, please contact your customer service representative to get the latest copy.

**Revisions**— A bold, black line alongside the text identifies changes in this publication since the last revision.

Woodward reserves the right to update any portion of this publication at any time. Information provided by Woodward is believed to be correct and reliable. However, no responsibility is assumed by Woodward unless otherwise expressly undertaken.

# Contents

<b>WARNINGS AND NOTICES</b> .....	<b>3</b>
<b>ELECTROSTATIC DISCHARGE AWARENESS</b> .....	<b>4</b>
<b>REGULATORY COMPLIANCE</b> .....	<b>5</b>
<b>CHAPTER 1. GENERAL INFORMATION</b> .....	<b>8</b>
Introduction.....	8
*Corrosive Fuels Recommendations .....	9
<b>CHAPTER 2. DESCRIPTION</b> .....	<b>28</b>
Electrical Mechanical Actuator Assembly .....	28
Brushless DC Motor .....	28
Resolver Position Feedback Sensors .....	28
Soft Stop Spring .....	28
Valve .....	28
<b>CHAPTER 3. INSTALLATION</b> .....	<b>29</b>
General.....	29
Piping Installation .....	31
Fuel Overboard Vent Connection .....	31
Valve Characteristic Data.....	32
Calibration .....	32
Valve/Actuator Configuration Settings .....	32
Electrical Connections.....	35
Preservation and Storage .....	37
<b>CHAPTER 4. MAINTENANCE AND HARDWARE REPLACEMENT</b> .....	<b>42</b>
Maintenance.....	42
Hardware Replacement .....	42
Ball Screw Lubrication Procedure.....	43
Bearing Lubrication Procedure.....	45
Fuel Overboard Vent Port .....	46
<b>CHAPTER 5. TROUBLESHOOTING</b> .....	<b>47</b>
<b>CHAPTER 6. SAFETY MANAGEMENT – SAFE POSITION FUEL SHUTOFF FUNCTION</b> .....	<b>49</b>
Product Variations Certified .....	49
Covered LESV Versions .....	49
SFF (Safe Failure Fraction) for the LESV – Over Speed SIF .....	49
Response Time Data .....	50
Limitations .....	50
Management of Functional Safety .....	50
Restrictions.....	50
Competence of Personnel.....	50
Operation and Maintenance Practice.....	50
Installation and Site Acceptance Testing .....	50
Functional Testing after Initial Installation.....	50
Functional Testing after Changes .....	51
Proof Test (Functional Test).....	51
Suggested Proof Test .....	51
Proof Test Coverage .....	51
<b>CHAPTER 7. PRODUCT SUPPORT AND SERVICE OPTIONS</b> .....	<b>52</b>
Product Support Options .....	52
Product Service Options .....	52
Returning Equipment for Repair .....	53
Replacement Parts.....	54

Engineering Services .....	54
Contacting Woodward's Support Organization .....	54
Technical Assistance .....	55
<b>REVISION HISTORY .....</b>	<b>56</b>
<b>DECLARATIONS .....</b>	<b>58</b>

## Illustrations and Tables

Figure 1-1a. Outline Drawing (2-Inch LESV Class 300) .....	10
Figure 1-1b. Outline Drawing (2-Inch LESV Class 300) .....	11
Figure 1-2a. Outline Drawing (2-Inch LESV Class 600) .....	12
Figure 1-2b. Outline Drawing (2-Inch LESV Class 600) .....	13
Figure 1-3a. Outline Drawing (3-Inch LESV Class 300) .....	14
Figure 1-3b. Outline Drawing (3-Inch LESV Class 300) .....	15
Figure 1-4a. Outline Drawing (3-Inch LESV Class 600) .....	16
Figure 1-4b. Outline Drawing (3-Inch LESV Class 600) .....	17
Figure 1-5a. Outline Drawing (4-Inch LESV Class 300) .....	18
Figure 1-5b. Outline Drawing (4-Inch LESV Class 300) .....	19
Figure 1-6a. Outline Drawing (4-Inch LESV Class 600) .....	20
Figure 1-6b. Outline Drawing (4-Inch LESV Class 600) .....	21
Figure 1-7a. Outline Drawing (6-Inch LESV Class 300) .....	22
Figure 1-7b. Outline Drawing (6-Inch LESV Class 300) .....	23
Figure 1-8a. Outline Drawing (6-Inch LESV Class 600) .....	24
Figure 1-8b. Outline Drawing (6-Inch LESV Class 600) .....	25
Figure 1-9. Representative Outline Deviation of High Recovery Valves .....	26
Figure 1-10. Connector Pin-outs .....	27
Figure 3-1. Illustration of Diverging Sleeve Screws .....	29
Figure 3-2. Illustration of Raised Face Style Diverging Sleeve .....	30
Figure 3-3. Illustration of Extension Style Diverging Sleeve .....	30
Figure 3-4. Power Connector .....	36
Figure 3-5. Motor Resolver Connectors .....	36
Figure 3-6. ID Module/Shaft Resolver Actuator Connector .....	37
Figure 3-7. Cable, Motor Resolver 1, Feedback Signal .....	38
Figure 3-8. Cable, Stem Shaft Resolver, Feedback Signal .....	39
Figure 3-9. Cable, Motor Power .....	40
Figure 3-10. Cable, Motor Resolver 2, Feedback Signal .....	41
Table 1-1. LESV Large Electric Sonic Valve Specifications .....	8
Table 1-2. Dimensions "L" and "D" per Figure 1-5 for High Recovery LESVs .....	26
Table 1-3. Dimensions "L" and "D" per Figure 1-5 for Ultra High Recovery LESVs .....	26
Table 3-1. Piping Loads According to Valve Size .....	31
Table 3-2. Valve Part Number Specific Parameters .....	33
Table 3-3. Valve Serial Number Specific Parameters .....	34
Table 5-1. Troubleshooting Symptom, Cause, and Remedy .....	47
Table 6-1. Failure Rates according to IEC61508 in FIT .....	49
Table 6-2. Suggested Proof Test .....	51
Table 6-3. Proof Test Coverage .....	51

## Warnings and Notices

### Important Definitions



This is the safety alert symbol used to alert you to potential personal injury hazards. Obey all safety messages that follow this symbol to avoid possible injury or death.

- **DANGER** - Indicates a hazardous situation, which if not avoided, will result in death or serious injury.
- **WARNING** - Indicates a hazardous situation, which if not avoided, could result in death or serious injury.
- **CAUTION** - Indicates a hazardous situation, which if not avoided, could result in minor or moderate injury.
- **NOTICE** - Indicates a hazard that could result in property damage only (including damage to the control).
- **IMPORTANT** - Designates an operating tip or maintenance suggestion.

#### **WARNING**

**Overspeed /  
Overtemperature /  
Overpressure**

The engine, turbine, or other type of prime mover should be equipped with an overspeed shutdown device to protect against runaway or damage to the prime mover with possible personal injury, loss of life, or property damage.

The overspeed shutdown device must be totally independent of the prime mover control system. An overtemperature or overpressure shutdown device may also be needed for safety, as appropriate.

#### **WARNING**

**Personal Protective  
Equipment**

The products described in this publication may present risks that could lead to personal injury, loss of life, or property damage. Always wear the appropriate personal protective equipment (PPE) for the job at hand. Equipment that should be considered includes but is not limited to:

- Eye Protection
- Hearing Protection
- Hard Hat
- Gloves
- Safety Boots
- Respirator

Always read the proper Material Safety Data Sheet (MSDS) for any working fluid(s) and comply with recommended safety equipment.

#### **WARNING**

**Start-up**

Be prepared to make an emergency shutdown when starting the engine, turbine, or other type of prime mover, to protect against runaway or overspeed with possible personal injury, loss of life, or property damage.

## Electrostatic Discharge Awareness

### **NOTICE**

#### **Electrostatic Precautions**

Electronic controls contain static-sensitive parts. Observe the following precautions to prevent damage to these parts:

- Discharge body static before handling the control (with power to the control turned off, contact a grounded surface, and maintain contact while handling the control).
- Avoid all plastic, vinyl, and Styrofoam (except antistatic versions) around printed circuit boards.
- Do not touch the components or conductors on a printed circuit board with your hands or with conductive devices.

To prevent damage to electronic components caused by improper handling, read and observe the precautions in Woodward manual **82715**, *Guide for Handling and Protection of Electronic Controls, Printed Circuit Boards, and Modules*.

Follow these precautions when working with or near the control.

1. Avoid the build-up of static electricity on your body by not wearing clothing made of synthetic materials. Wear cotton or cotton-blend materials as much as possible because these do not store static electric charges as much as synthetics.
2. Do not remove the printed circuit board (PCB) from the control cabinet unless absolutely necessary. If you must remove the PCB from the control cabinet, follow these precautions:
  - Do not touch any part of the PCB except the edges.
  - Do not touch the electrical conductors, the connectors, or the components with conductive devices or with your hands.
  - When replacing a PCB, keep the new PCB in the plastic antistatic protective bag it comes in until you are ready to install it. Immediately after removing the old PCB from the control cabinet, place it in the antistatic protective bag.

## Regulatory Compliance

### European Compliance for CE Marking:

These listings are limited only to those units bearing the CE Marking.

**EMC Directive:** Declared to Directive 2014/30/EU of the European Parliament and of the Council of 26 February 2014 on the harmonization of the laws of the Member States relating to electromagnetic compatibility (EMC).

**Pressure Equipment Directive:** Directive 2014/68/EU on the harmonisation of the laws of the Member States relating to making pressure equipment available on the market.  
2-Inch, 3-Inch, 4-Inch: PED Category II  
6-Inch: PED Category III  
PED Module H – Full Quality Assurance

**ATEX – Potentially Explosive Atmospheres Directive:** Directive 2014/34/EU on the harmonisation of the laws of the Member States relating to equipment and protective systems intended for use in potentially explosive atmospheres.  
Zone 2, Category 3, Group II G, Ex ec IIC T3 Gc

### Other European Compliance:

Compliance with the following European Directives or standards does not qualify this product for application of the CE Marking:

**RoHS Directive:** Restriction of Hazardous Substances 2011/65/EU:  
Woodward Turbomachinery Systems products are intended exclusively for sale and use only as a part of Large Scale Fixed Installations per the meaning of Art.2.4(e) of directive 2011/65/EU. This fulfills the requirements stated in Art.2.4(c) and as such the product is excluded from the scope of RoHS2.

**ATEX:** Exempt from the non-electrical portion of the ATEX Directive 2014/34/EU due to no potential ignition sources per EN ISO 80079-36:2016 for Zone 2 installation.

**Machinery Directive:** Compliant as partly completed machinery with Directive 2006/42/EC of the European Parliament and the council of 17 May 2006 on machinery.

### Other International Compliance:

**IECEx (LELA Actuator):** Certified for use in explosive atmospheres per Certificate IECEx CSA 14.0013X Ex ec IIC T3 Gc IP55

### EAC Customs Union:

These listings are limited only to those units with labels, marking, and manuals in Russian language to comply with their certificates and declaration.

**EAC Customs Union (Marked):** Certified to Technical Regulation CU 012/2011 for use in potentially explosive atmospheres and marked as 2Ex nA IIC T3 Gc X for electrical and II Gc TX for non-electrical portions of the valve.

- EAC Customs Union (Marked):** Certified to Technical Regulation CU 032/2013 on the safety of equipment operating under excessive pressure.
- EAC Customs Union:** Declared to Technical Regulation CU 032/2013 on the safety of equipment operating under excessive pressure.
- EAC Customs Union:** Declared to Technical Regulation CU 010/2011 on the safety of machinery and equipment. Declared to Technical Regulation CU 020/2011 on Electromagnetic Compatibility of Technical Equipment.
- Korean Certification (KC Mark):** KCs Certificate No. 16-KA4BO-0387X  
Applicable Safety Certification Notice No. 2021-22  
Installation of explosion proof equipment must comply with KS C IEC 60079-14.  
In relation to maintenance and repair, there is a limit of responsibility of the user and the manufacturer such as the method and subject.

**INMETRO Certification:**

These listings are limited only to those units with labels, marking, and manuals in Portuguese language to comply with their certificates and declaration.

**INMETRO Brazil:** NCC Certificate: BRA 23.GE0014X  
Ex nA IIC T3 Gc

**North American Compliance:**

These listings are limited only to those units bearing the CSA Marking.

**CSA (Actuator):** CSA Certified for Class I, Division 2, Groups A, B, C, & D, T3 at 93 °C Ambient For use in Canada and the United States Certificate 1635932.

Actuator is certified for North America as on-engine systems component connected to the certified Digital Valve Positioner.

**SIL Compliance:**

LESV – Certified SIL 3 Capable for safe position Fuel shutoff function in safety instrumented systems. Evaluated to IEC 61508 Parts 1-2. Refer to the instructions of this Installation and Operation Manual, Chapter 6 – Safety Management – Safe Position Fuel Shutoff Function.

SIL Certificate WOO 1405129 C001

[Link to Exida SIL 3 Certification](#)

**Special Conditions for Safe Use:**

- Mating connectors must be installed to maintain IP55 rating.
- Connect the ground terminal to earth ground.
- Maximum ambient temperature 93 °C (200 °F).
- Use supply wires suitable for 10 °C (18 °F) above surrounding ambient.

Compliance with the Machinery Directive 2006/42/EC noise measurement and mitigation requirements is the responsibility of the manufacturer of the machinery into which this product is incorporated.

Wiring must be in accordance with North American Class I, Division 2, or European Zone 2, Category 3 wiring methods as applicable, and in accordance with the authority having jurisdiction.



**EXPLOSION HAZARD—Do not remove covers or connect/disconnect electrical connectors unless power has been switched off or the area is known to be non-hazardous.**

**Substitution of components may impair suitability for Class I, Division 2 or Zone 2.**



**RISQUE D'EXPLOSION—Ne pas enlever les couvercles, ni raccorder / débrancher les prises électriques, sans vous en assurer auparavant que le système a bien été mis hors tension; ou que vous situez bien dans une zone non explosive.**

**La substitution de composants peut rendre ce matériel inacceptable pour les emplacements de Classe I, Division 2 ou Zone 2.**

# Chapter 1.

## General Information

### Introduction

The Large Electric Sonic Valve (LESV) controls the flow of gas fuel to the combustion system of an industrial or utility gas turbine. The integral electric actuator consists of a brushless dc motor, resolver for motor commutation and position sensing, valve stem resolver for motor resolver verification, fail-safe spring for fail-safe operation, and a soft stop for fail-safe operations. The LESV utilizes a device (ID Module) containing all the configuration and calibration information that is read by the Digital Valve Positioner (DVP) when the valve/actuator is connected and powered up.

This valve is intended to operate only with a Woodward Digital Valve Positioner (DVP). Contact your sales person for part numbers for your specific applications.

Table 1-1. LESV Large Electric Sonic Valve Specifications

Description	2, 3, 4, & 6-inch (51, 76, 102, 152 mm) electrically actuated natural gas sonic metering valve.	
Mean Time Between Failure (MTBF)	149 000 hrs. operation combined metering valve per valve/actuator/DVP/cable subsystem.	
Ambient Temperature Range	-40 to +93 °C (-40 to +200 °F)	
Approximate Weights	Class 300 LESV	Class 600 LESV
	2-Inch - 113 kg / 250 lb.	2-Inch - 113 kg / 250 lb.
	3-Inch - 161 kg / 356 lb.	3-Inch - 167 kg / 368 lb.
	4-Inch - 195 kg / 430 lb.	4-Inch - 207 kg / 456 lb.
	6-Inch - 256 kg / 565 lb.	6-Inch - 278 kg / 613 lb.
<b>ACTUATOR</b>		
Description	Brushless dc motor with dual position feedback sensors.	
Coil	Class H insulation.	
Failure Mode	Spring type to drive valve to safe position with loss of signal (Fail Close).	
Bandwidth	35 rad/s with no more than 6 dB attenuation and less than 180 degrees phase loss at ±2% magnitude and minimum supply voltage at DVP.	
Visual Position Indication	Yes	
Ingress Protection	IP55	
Characteristic	High Recovery LESV	Ultra-High Recovery LESV
	2-Inch—200 ms	2-Inch—400 ms
	3-Inch—350 ms	3-Inch—700 ms
	4-Inch—700 ms	4-Inch—700 ms
	6-Inch—700 ms	6-Inch—700 ms
DVP Input Voltage (typical)	125 Vdc	220 Vdc
DVP Input Voltage (max)	150 Vdc	300 Vdc
DVP Input Voltage (min) (for full dynamic performance)	112.5 Vdc	112.5 Vdc

Table 1-1. LESV Large Electric Sonic Valve Specifications (cont'd.)

<b>VALVE</b>			
Operating Fluid	Natural Gas*		
Gas Filtration	25 µm absolute at 75 beta requirement.		
Valve Flange Connection	Class 300 Flange High Recovery LESV	Class 600 Flange High Recovery LESV	Class 600 Flange Ultra High Recovery LESV
Min Fluid Temperature	-29 °C (-20 °F)	-29 °C (-20 °F)	-29 °C (-20 °F)
Max Fluid Temperature	232 °C (450 °F)	260 °C (500 °F)	260 °C (500 °F)
Min Fluid Pressure	0 kPa (0 psig)	0 kPa (0 psig)	0 kPa (0 psig)
Max Fluid Pressure	3902 kPa at 38 °C (566 psig at 100 °F)	4000 kPa at 38 °C (580 psig at 100 °F)	4171 kPa at 38 °C (605 psig at 100 °F)
	3434 kPa at 232 °C (498 psig at 450 °F)	4000 kPa at 260 °C (580 psig at 500 °F)	4171 kPa at 260 °C (605 psig at 500 °F)
Proof Test Pressure/Production	7584 kPa / 1100 psig	9136 kPa / 1325 psig	9480 kPa / 1375 psig
Burst Pressure	5x maximum operating pressure.		
Overboard Leakage	<50 cm <sup>3</sup> /min as shipped (see Fuel Overboard Vent Port section).		
Trim Sizes	Contact Woodward for various Cg trim sizes.		

### \*Corrosive Fuels Recommendations

Woodward valves are designed to meet the full performance and lifetime specifications only when operated in an environment with less than 20 ppm H<sub>2</sub>S. Woodward has no definitive performance experience for these valves operating above 20 ppm H<sub>2</sub>S and therefore recommends an annual inspection along with a scheduled overhaul interval of no more than 20,000 operating hours or two years, whichever comes first. **This is a change to our normal recommendation for overhaul at 48,000 operating hours.** During overhaul the valve will be evaluated, and further recommendations can be provided which may include an update to the overhaul schedule.

NOTE: Regarding Atmospheric Environment, Woodward products are designed based on non-corrosive gas conditions. Besides particulates, the atmospheric environment may also contain corrosive gases such as hydrogen sulfide, sulfur dioxide, nitrous oxide, and chlorine. Product printed circuit assemblies are basically conformal coated with a specialized polyacrylate that provides protection from corrosive gaseous sulfur compounds and corrosion accelerants such as NO<sub>x</sub> and chlorine. By necessity, some areas cannot be coated—such as connectors, jumpers, test points, and field terminations. The larger conductor spacing, thicker metallization, and corrosion resistant plating of these uncoated areas will mitigate the effects of corrosion for a time but not prevent eventual damage.

The sulfur resistant coating will provide protection for coated components in moderately severe atmospheric environments as described by ISA S71.04-19852 level “G2”, and IEC 721-3-3 1994 TABLE 4 Class 3C2 (Urban Industrial, Heavy Traffic). See Tables 2 and 3 of [Woodward Application Note 51530](#). Long-term use in more severe environments is not recommended because some critical reactive metal connection surfaces cannot be coated and corrosion will occur at a rate determined by the corrosive gas concentrations and mixtures, materials, temperature, and humidity.

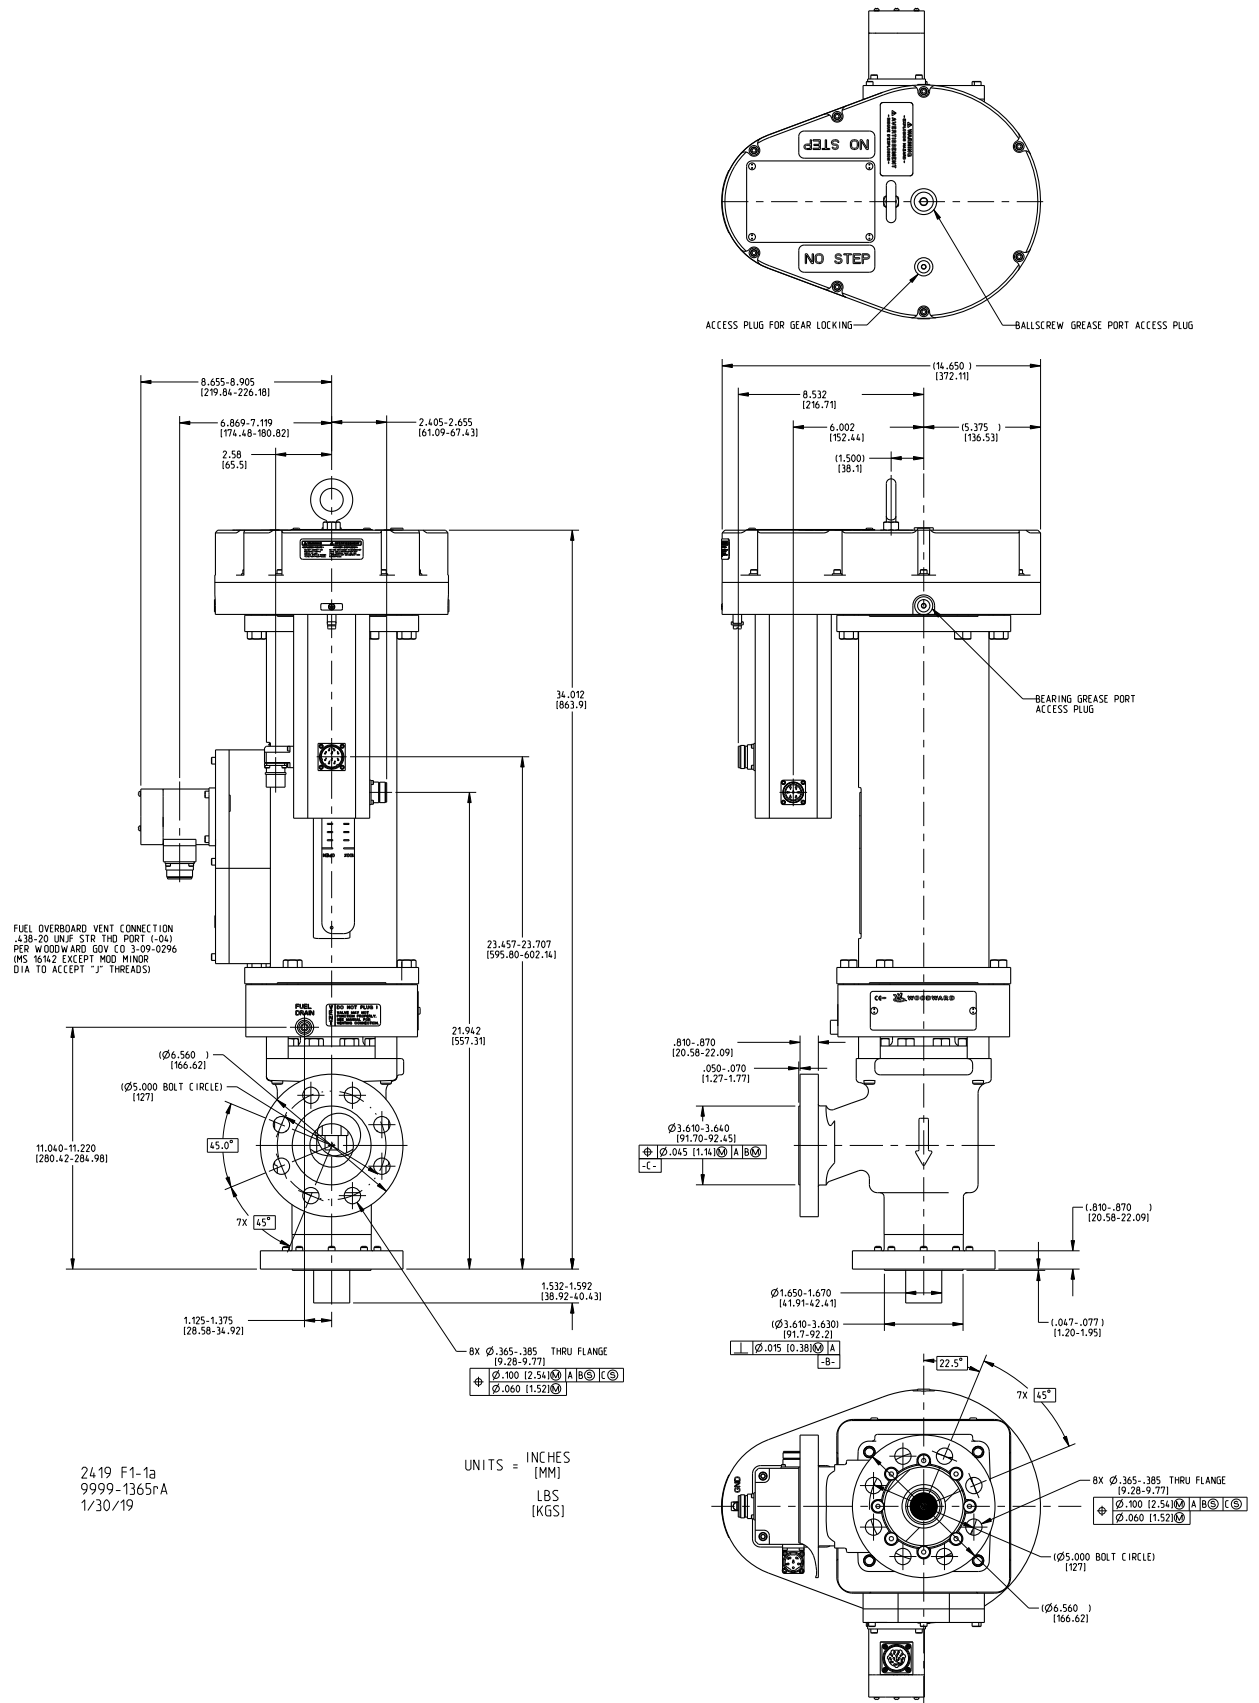


Figure 1-1a. Outline Drawing (2-Inch LESV Class 300)

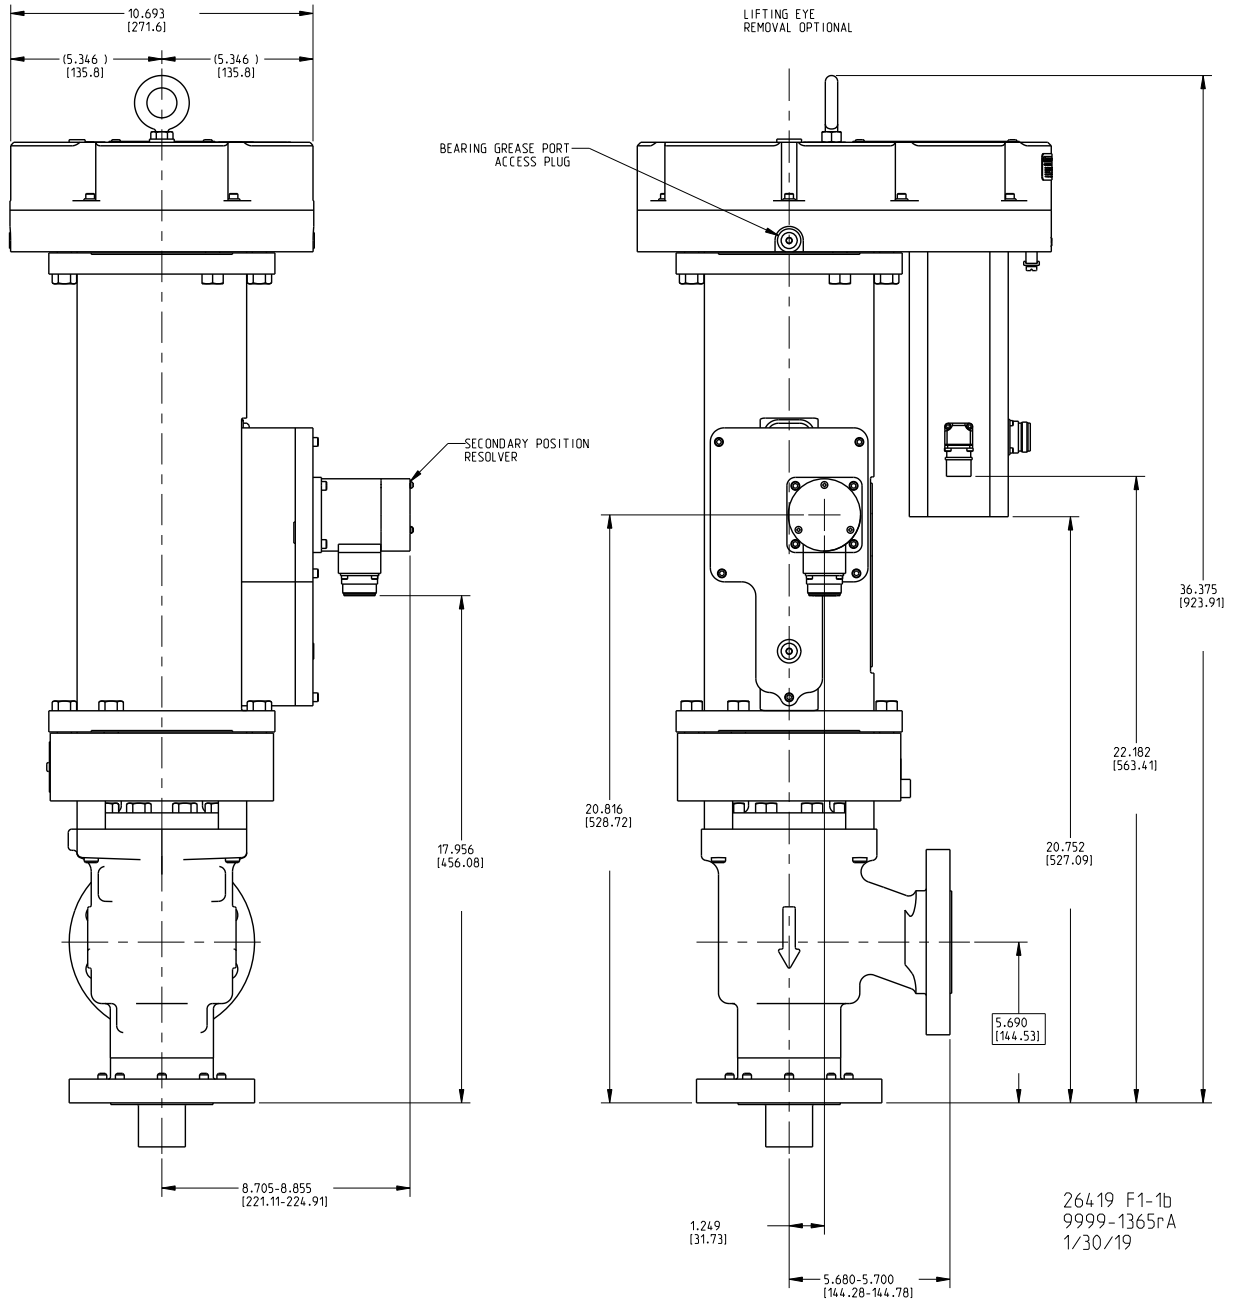


Figure 1-1b. Outline Drawing (2-Inch LESV Class 300)

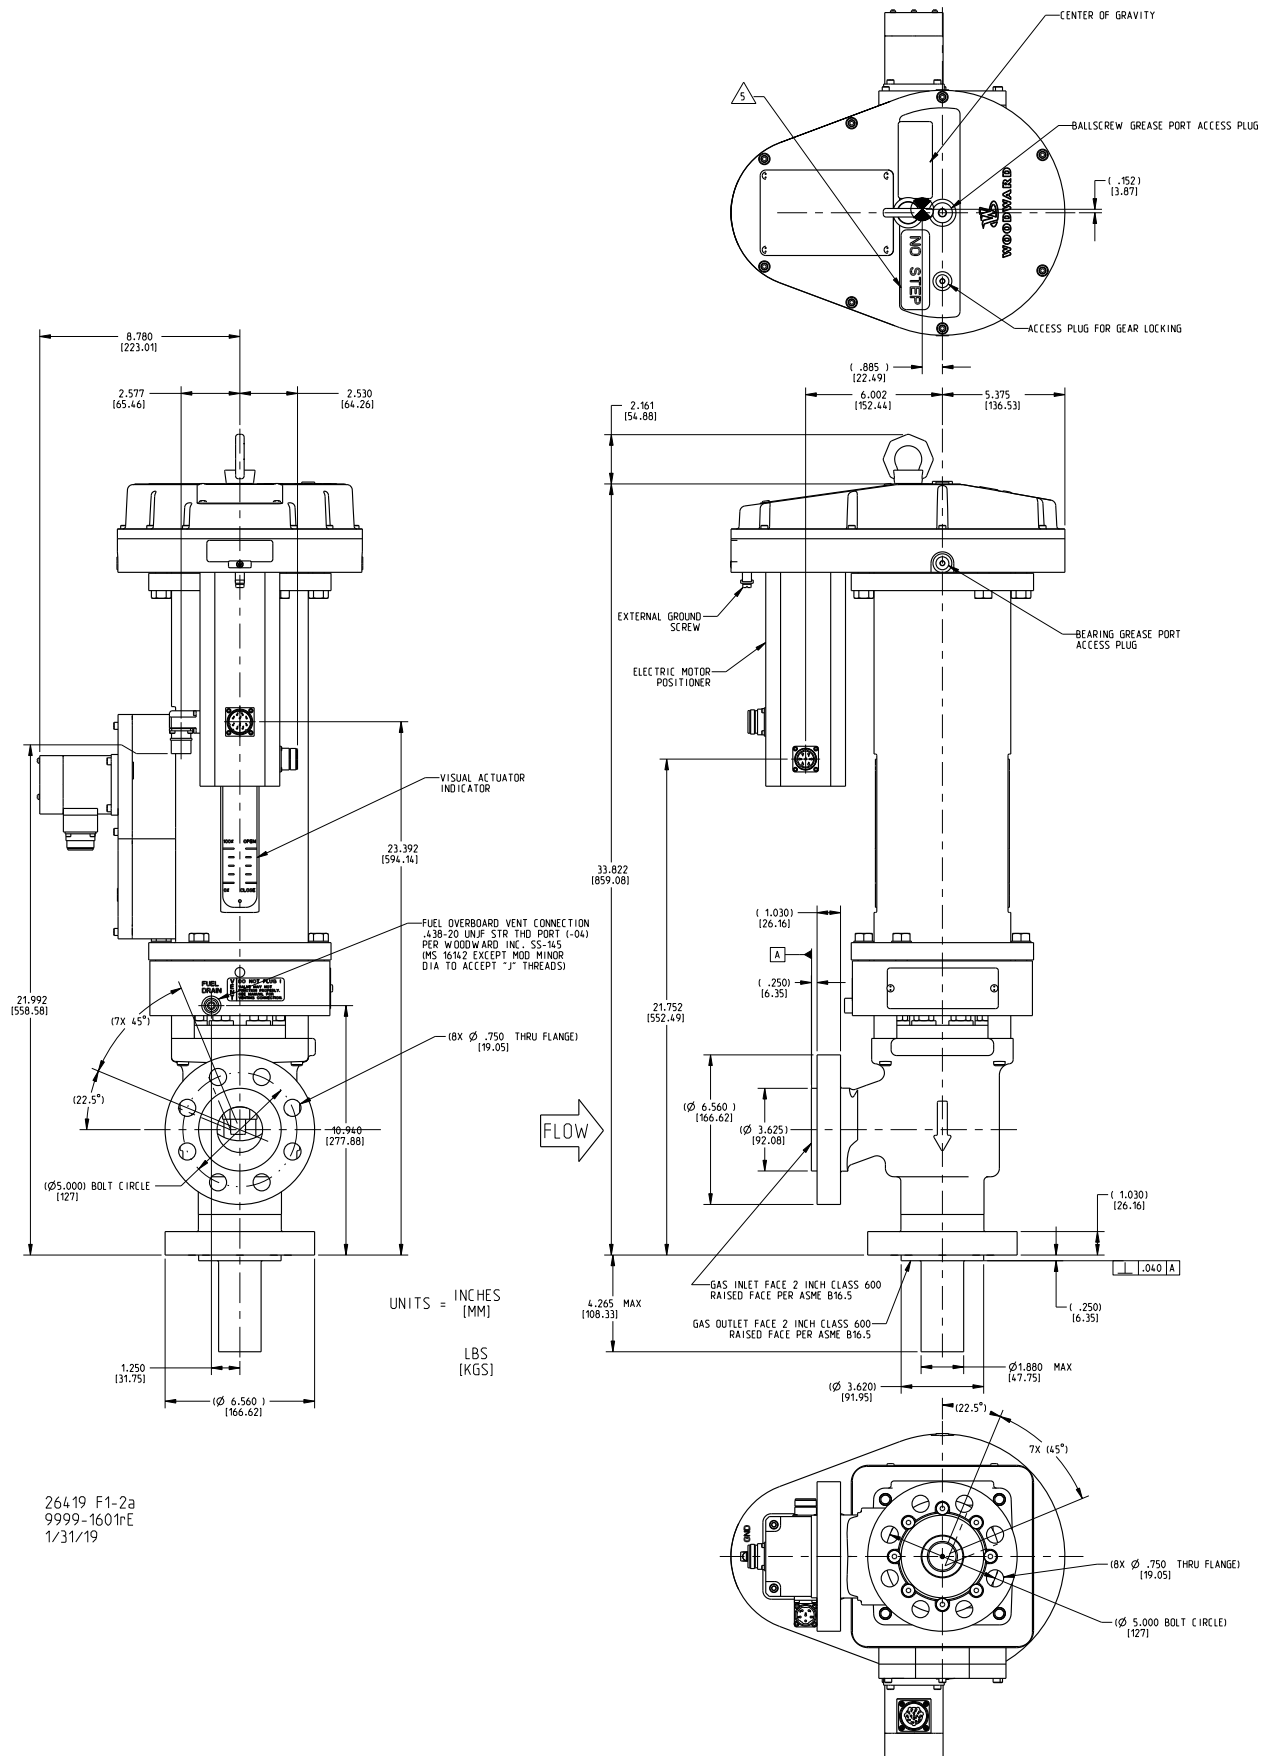


Figure 1-2a. Outline Drawing (2-Inch LESV Class 600)

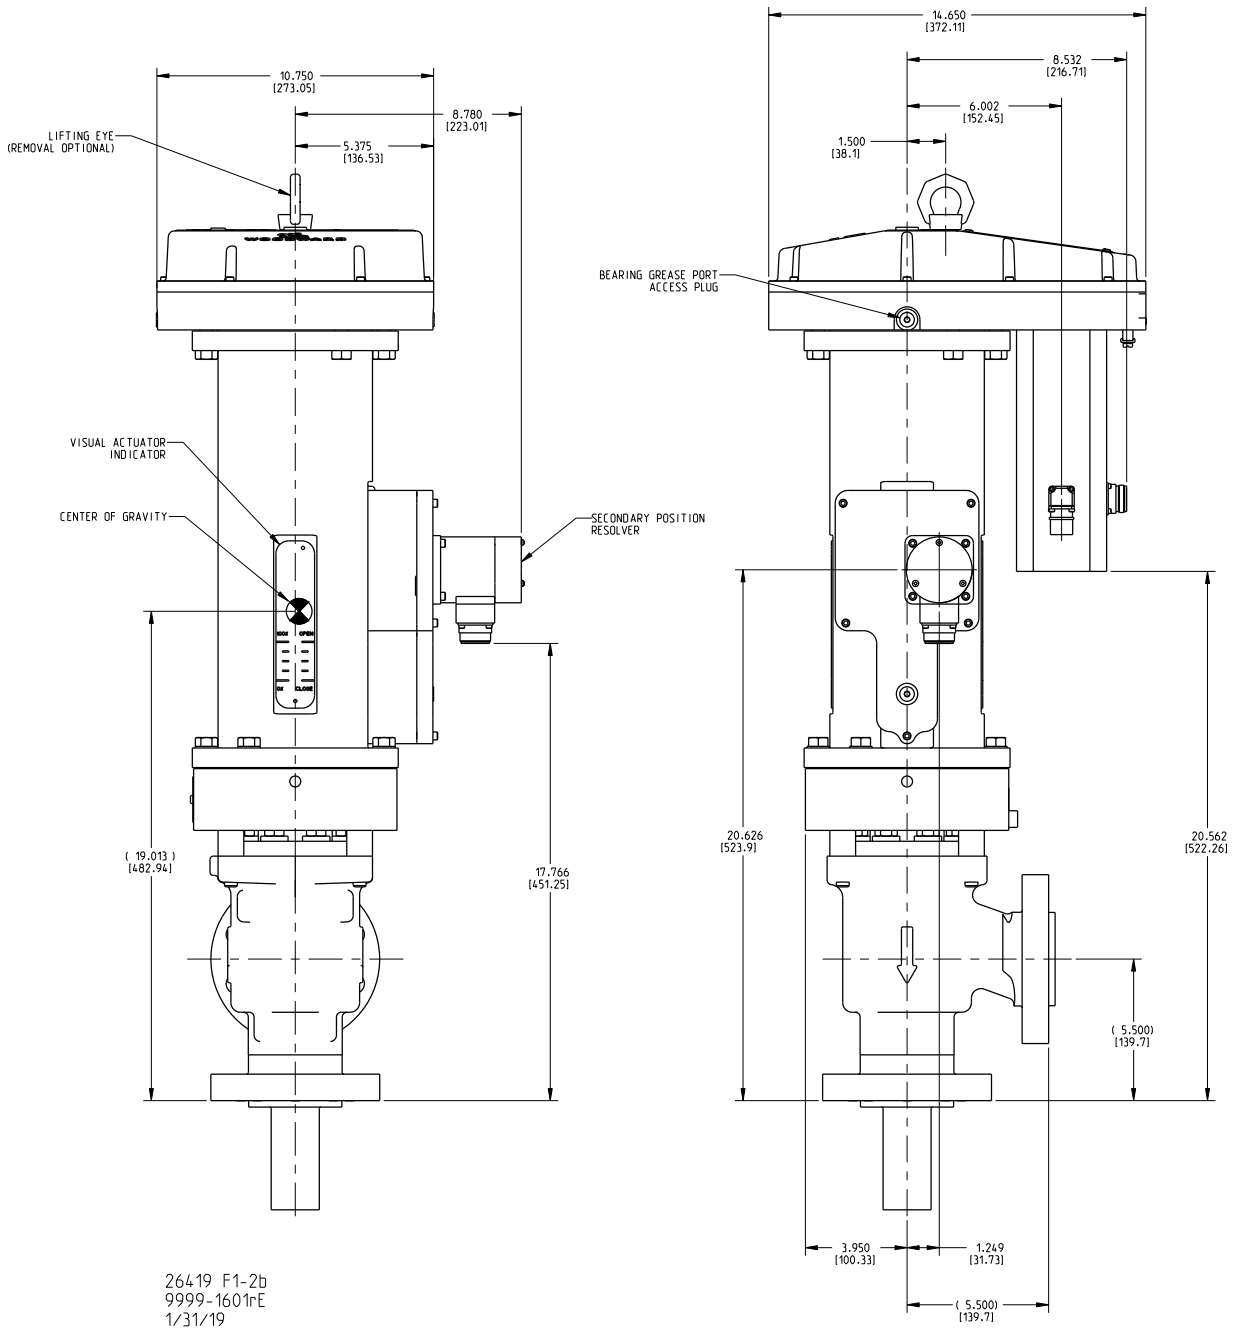


Figure 1-2b. Outline Drawing (2-Inch LESV Class 600)

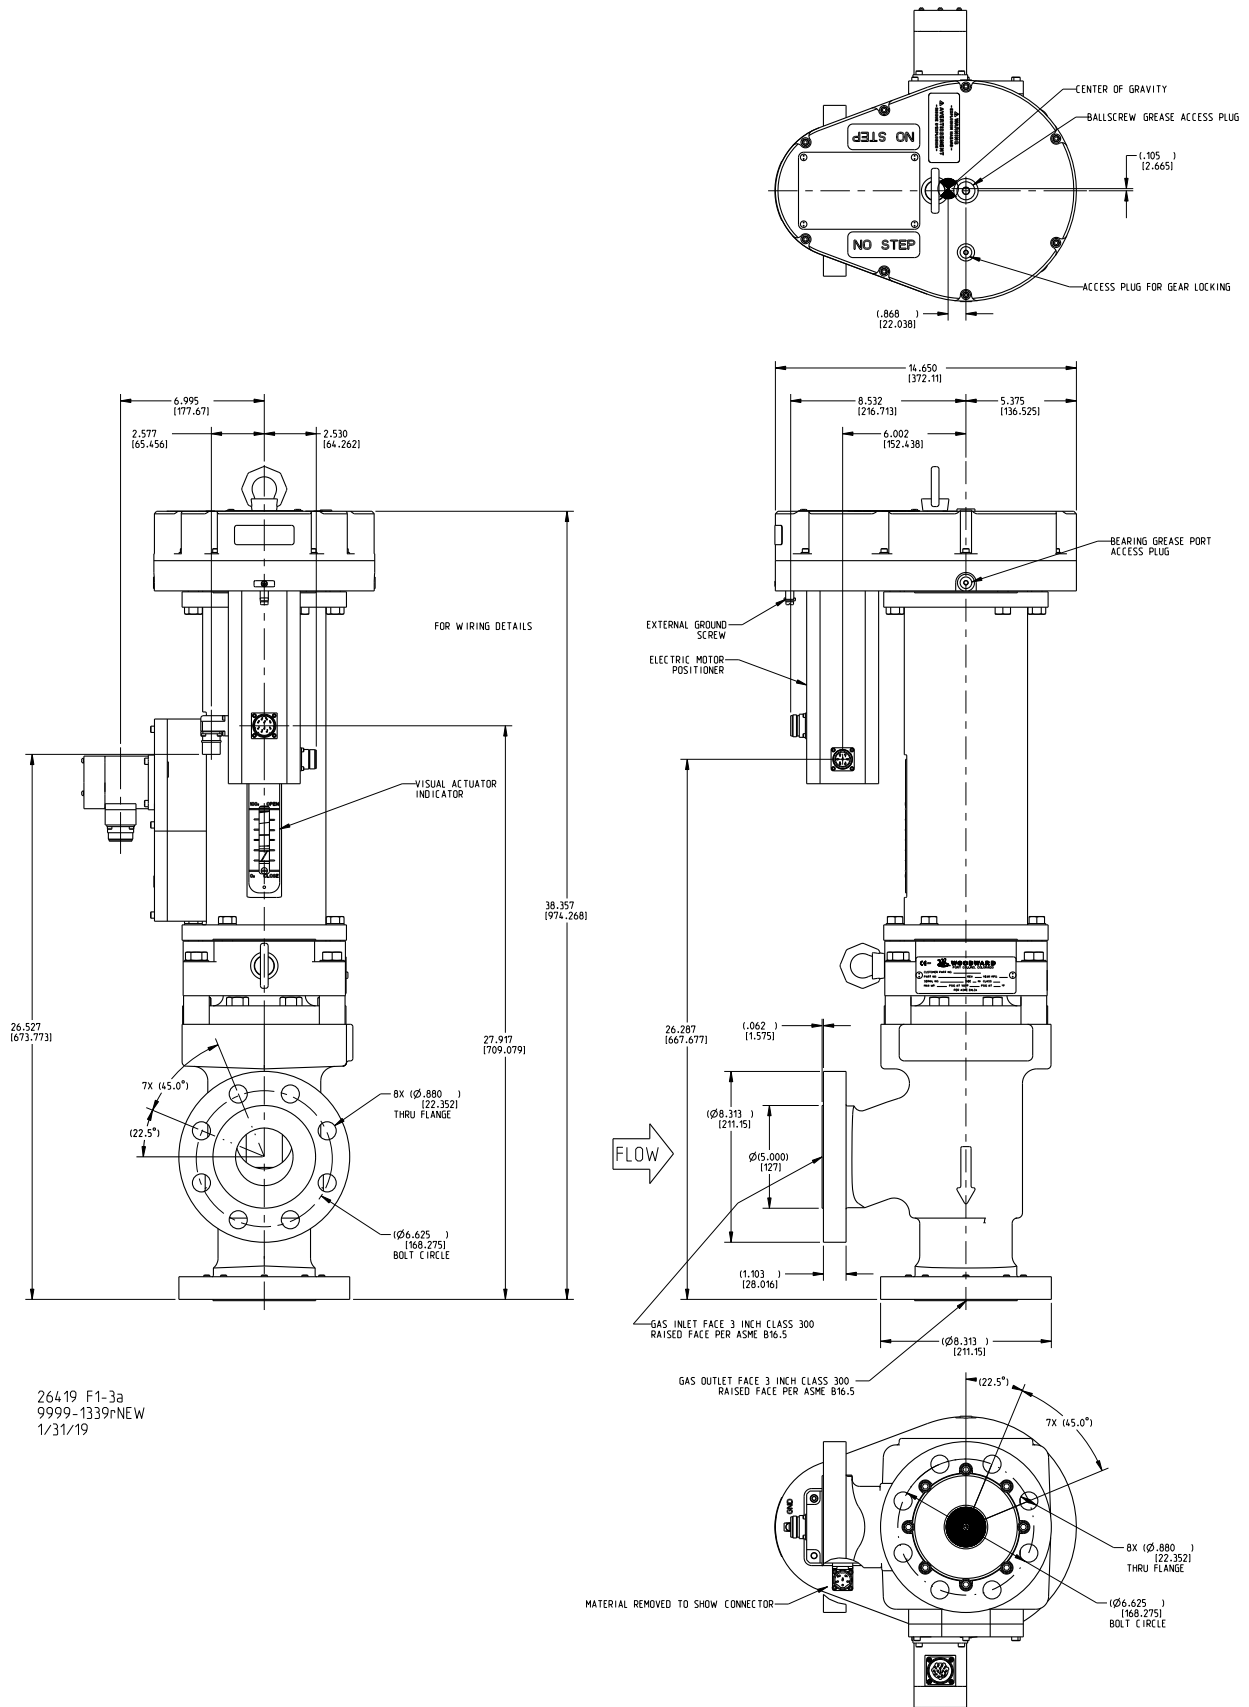


Figure 1-3a. Outline Drawing (3-Inch LESV Class 300)

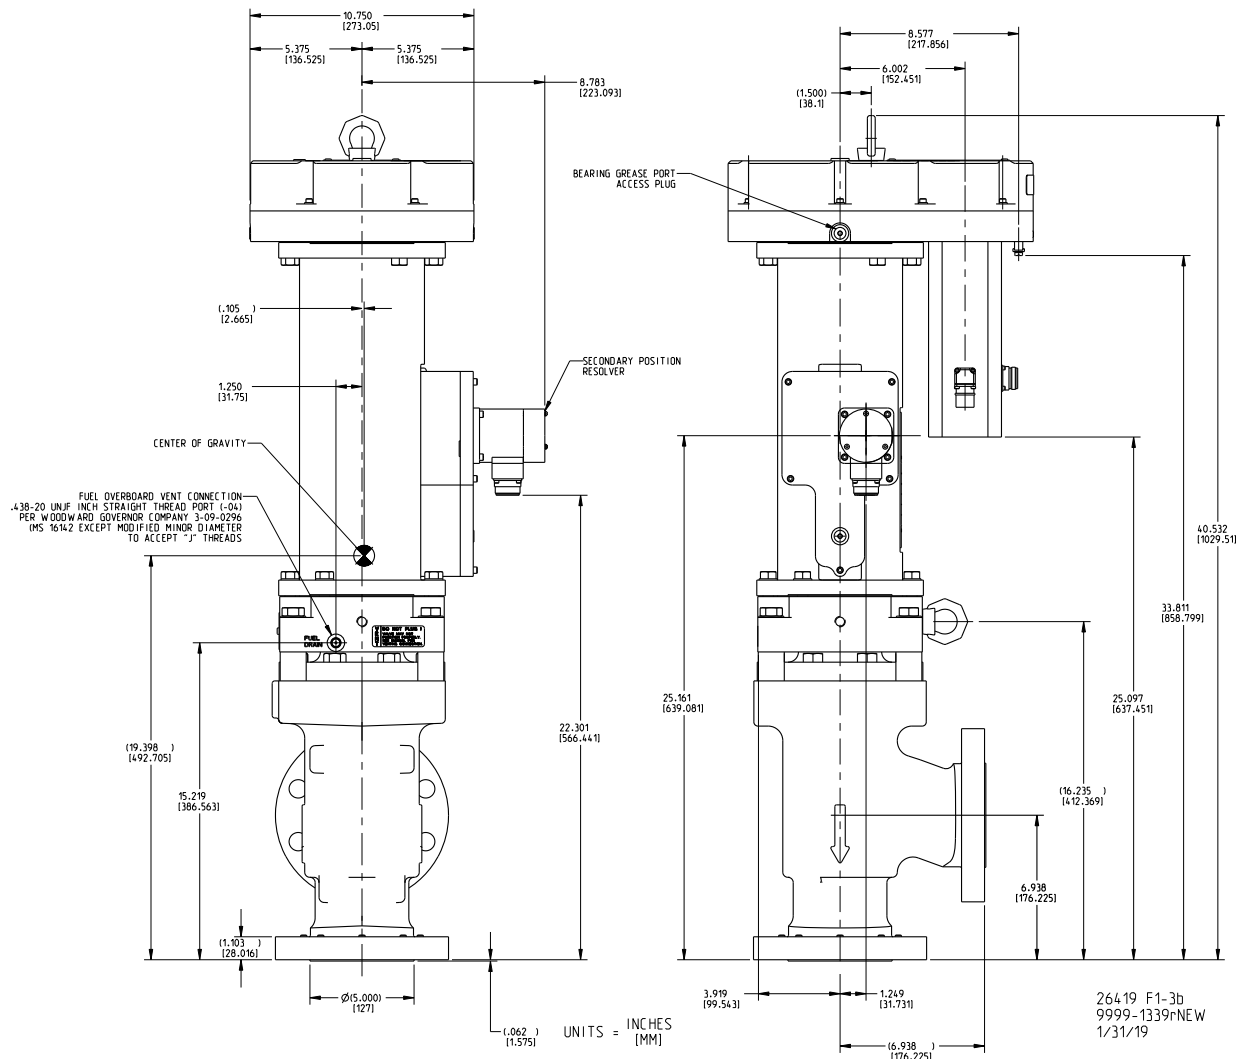


Figure 1-3b. Outline Drawing (3-Inch LESV Class 300)

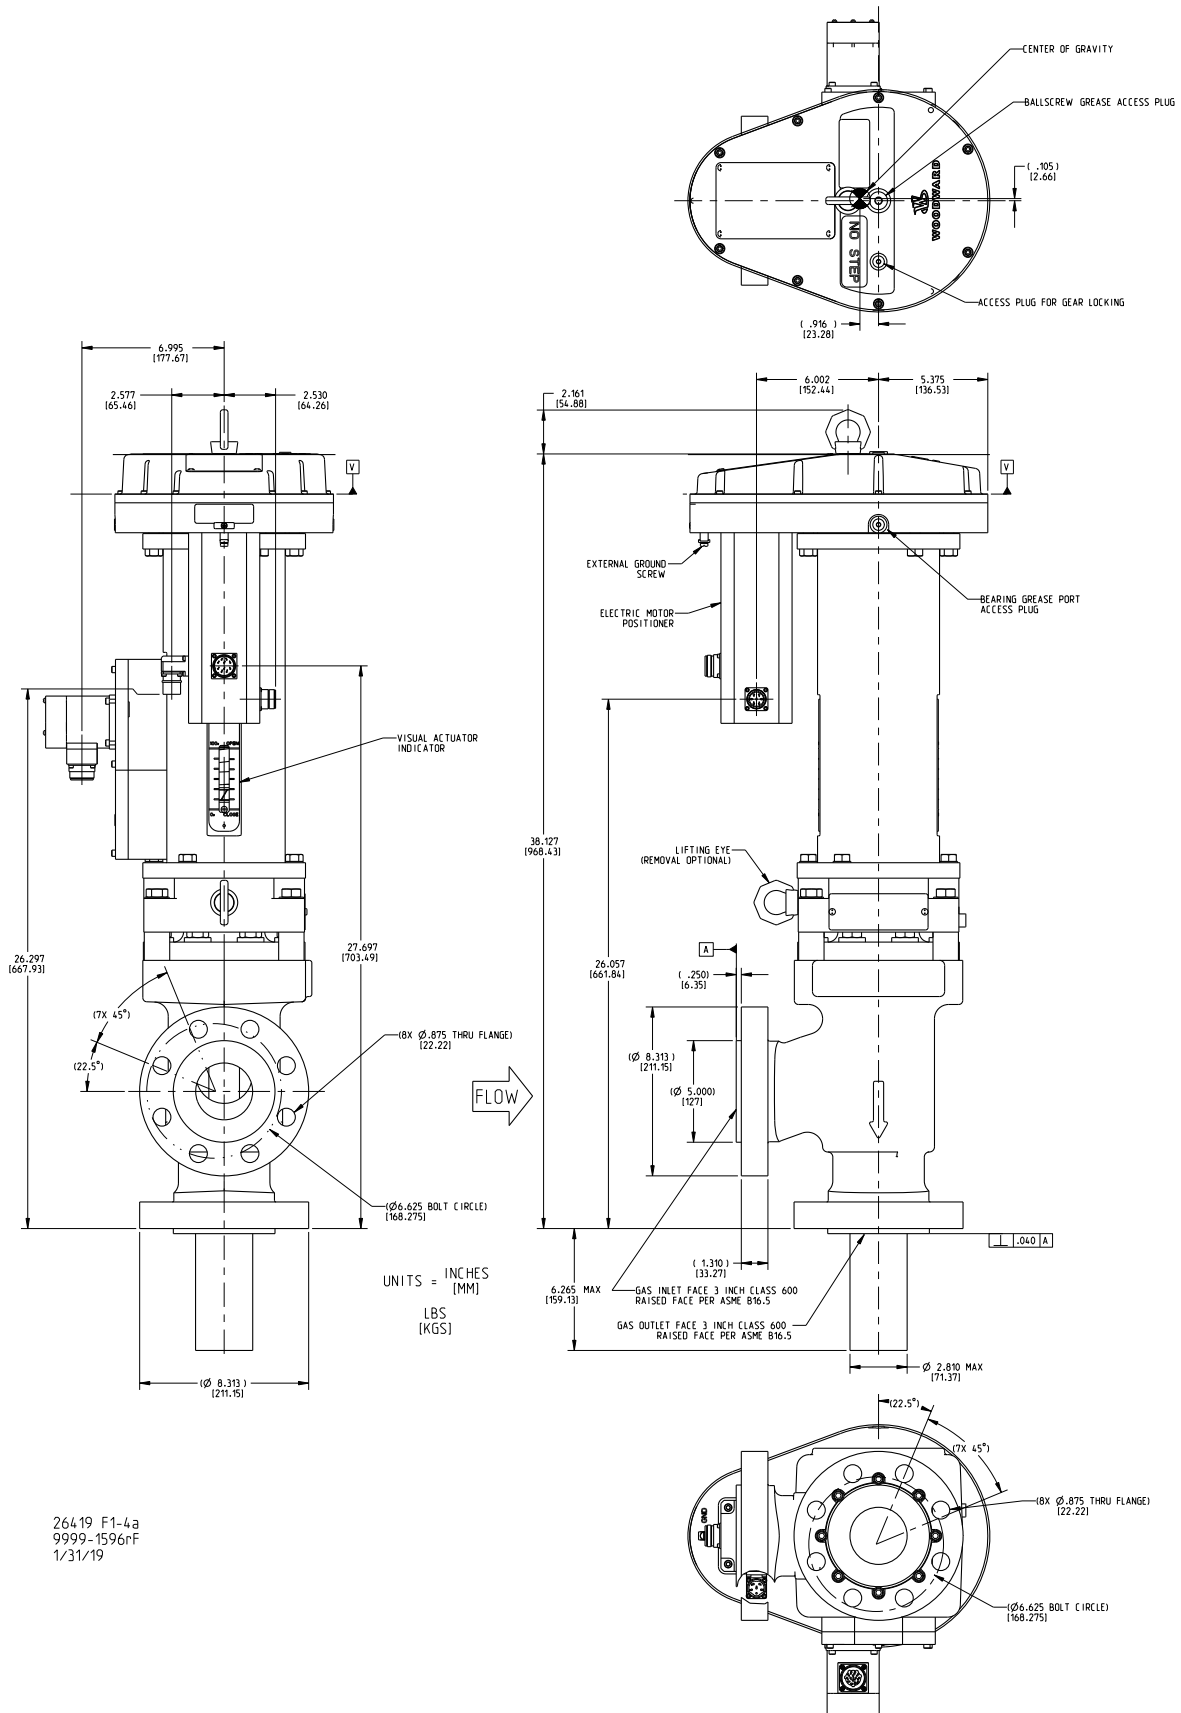


Figure 1-4a. Outline Drawing (3-Inch LESV Class 600)

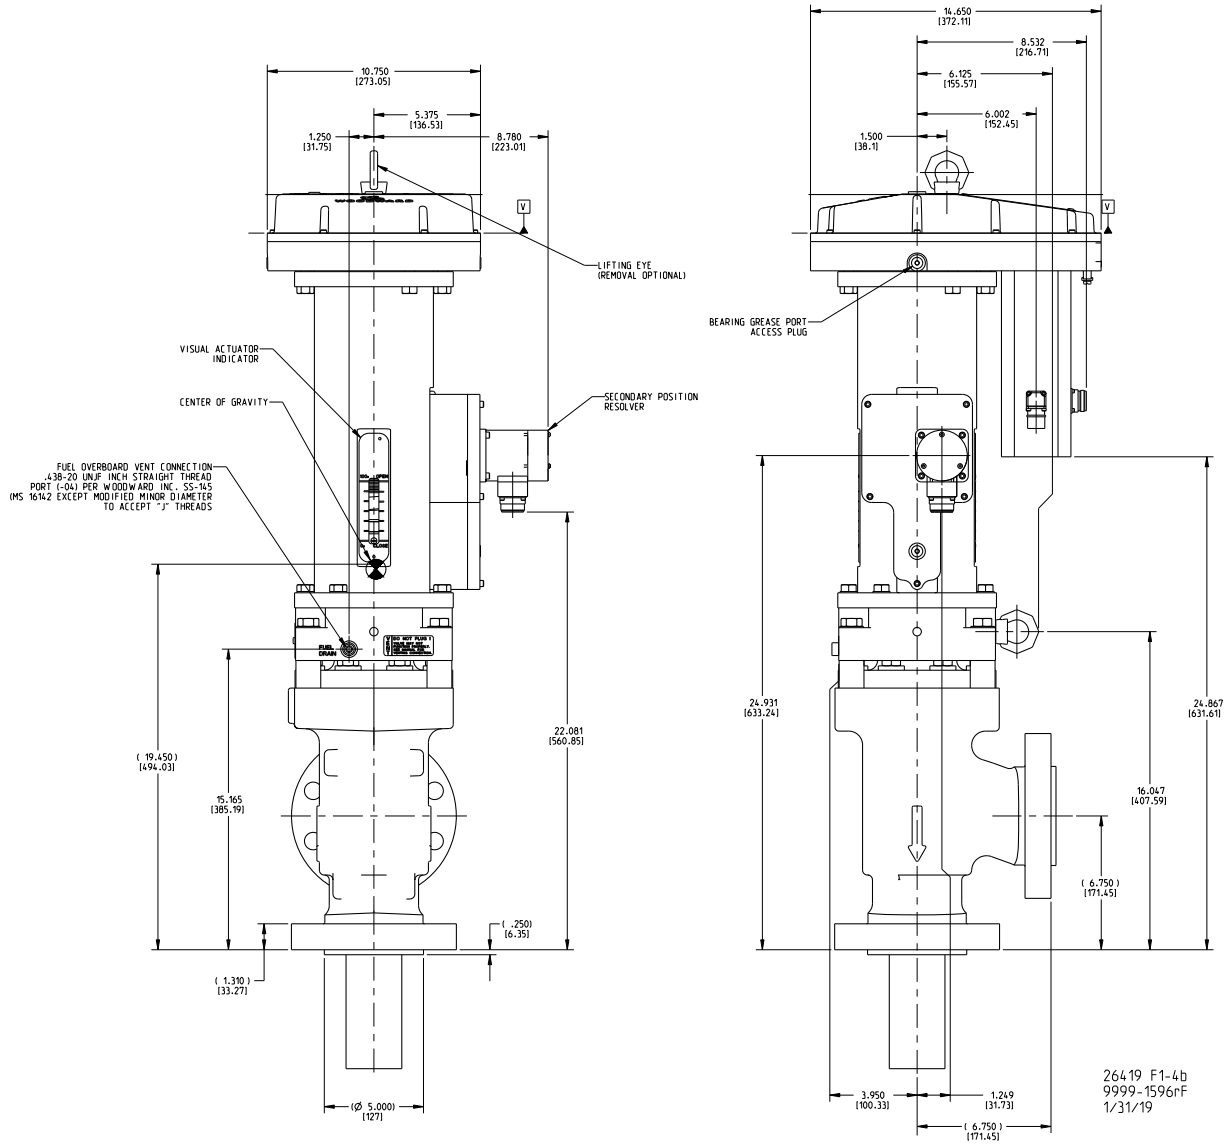


Figure 1-4b. Outline Drawing (3-Inch LESV Class 600)

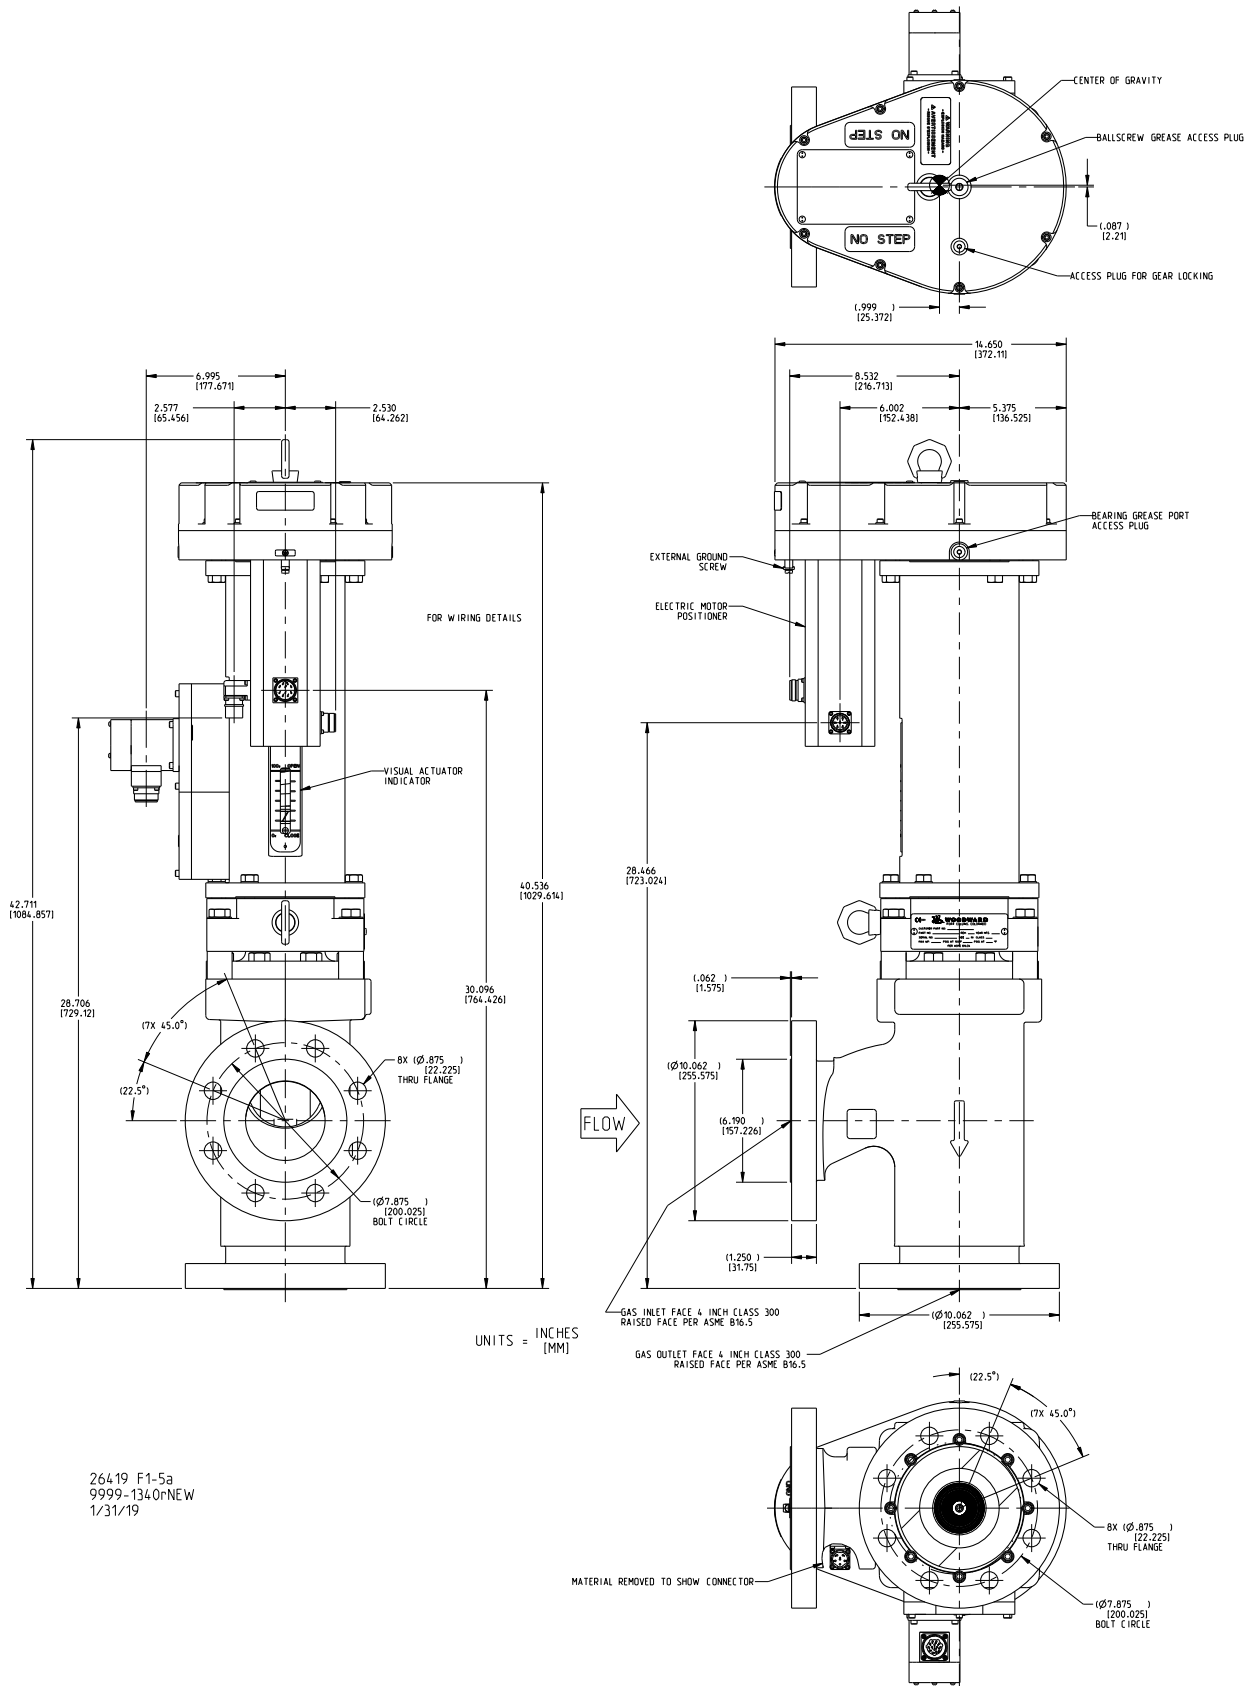


Figure 1-5a. Outline Drawing (4-Inch LESV Class 300)

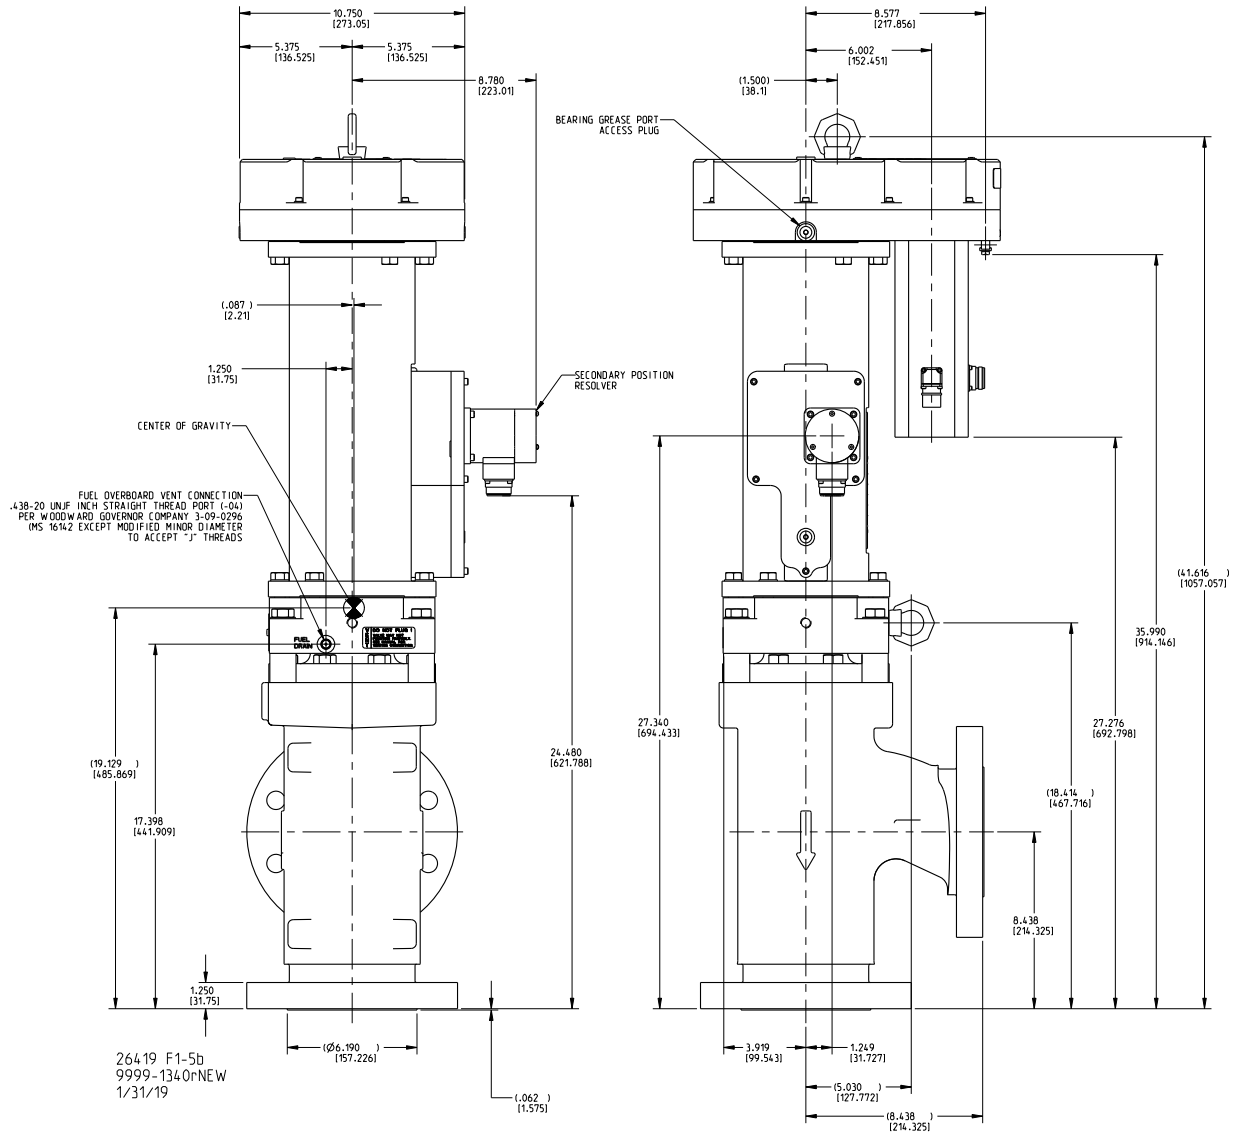


Figure 1-5b. Outline Drawing (4-Inch LESV Class 300)



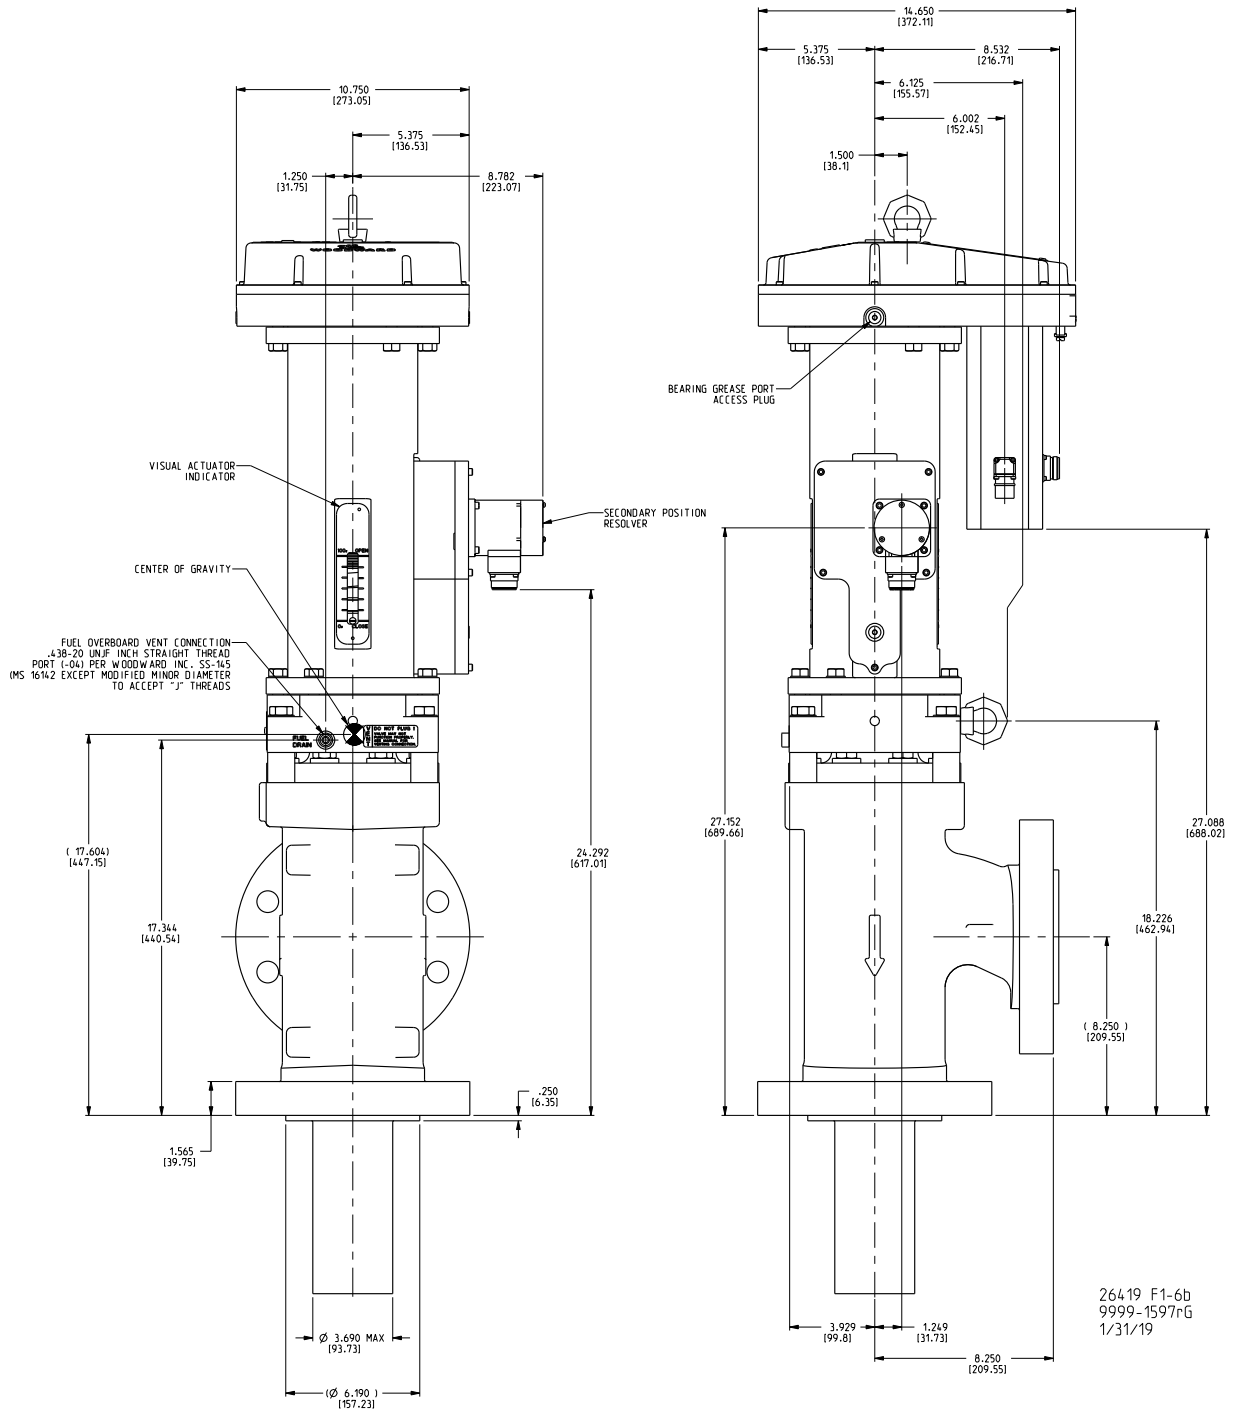


Figure 1-6b. Outline Drawing (4-Inch LESV Class 600)

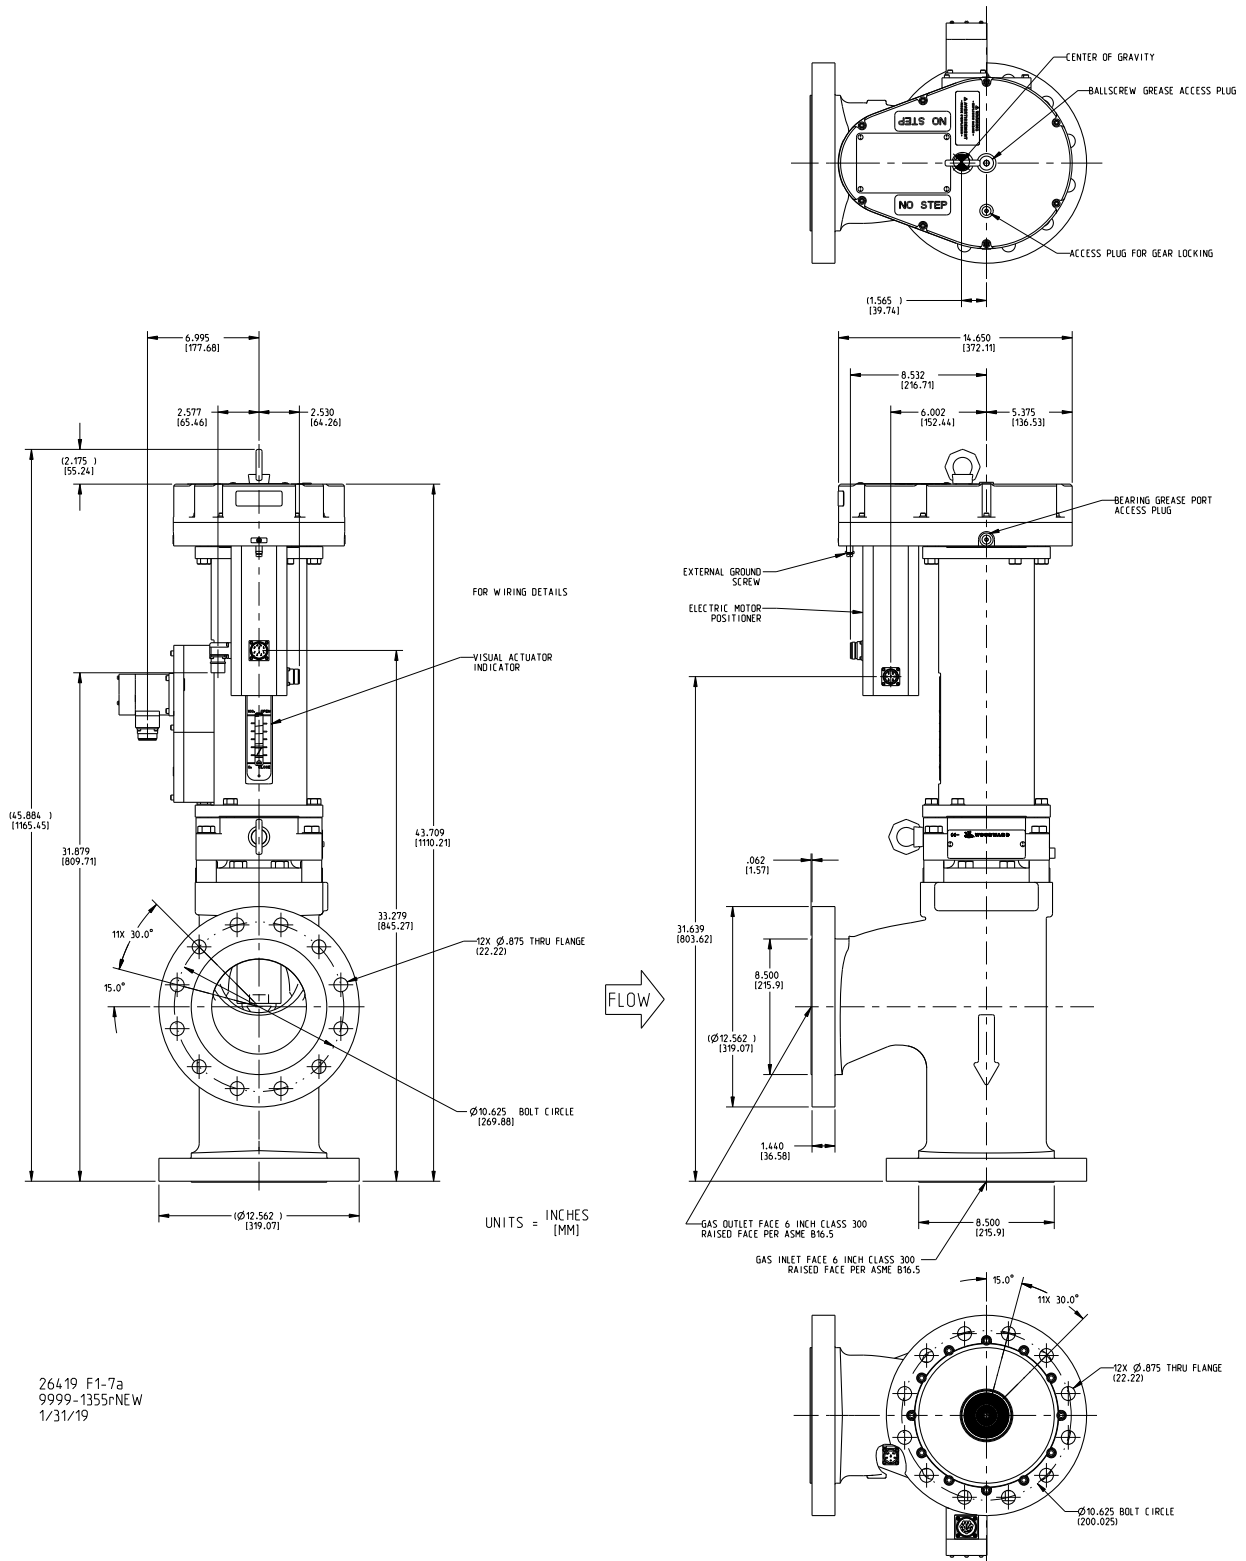


Figure 1-7a. Outline Drawing (6-Inch LESV Class 300)

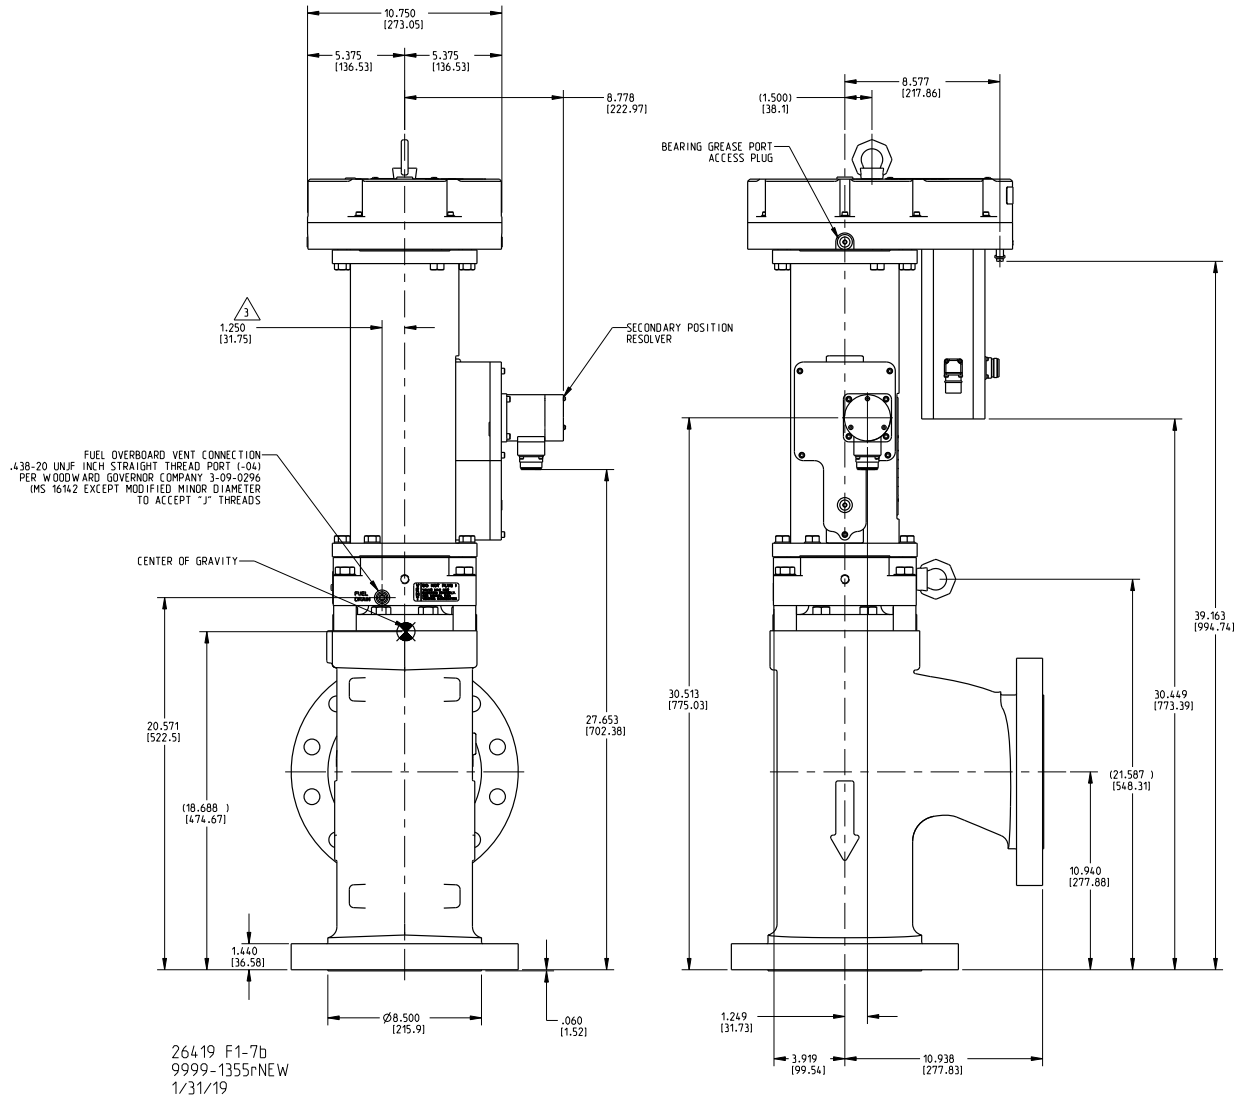


Figure 1-7b. Outline Drawing (6-Inch LESV Class 300)



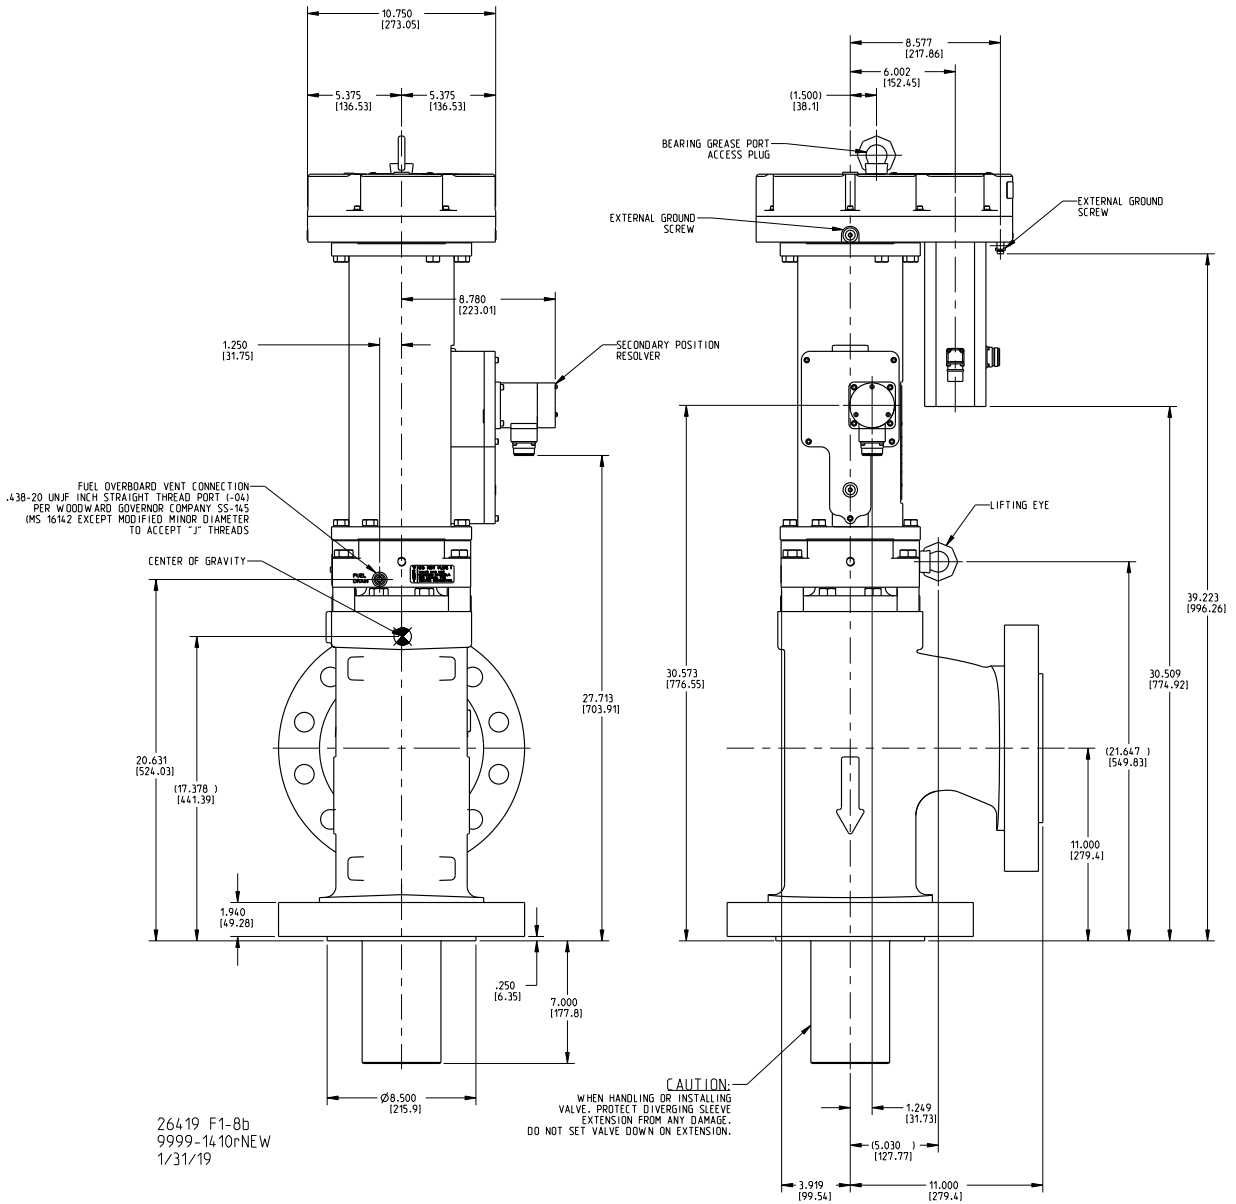


Figure 1-8b. Outline Drawing (6-Inch LESV Class 600)

In the event the valves supplied are considered High Recovery, the following feature (extension) is added in addition to the outline drawing dimensions for the outlet flange. Take care not to damage the extension.

NOTICE	Do NOT use the extension to support the valve in any manner.
--------	--

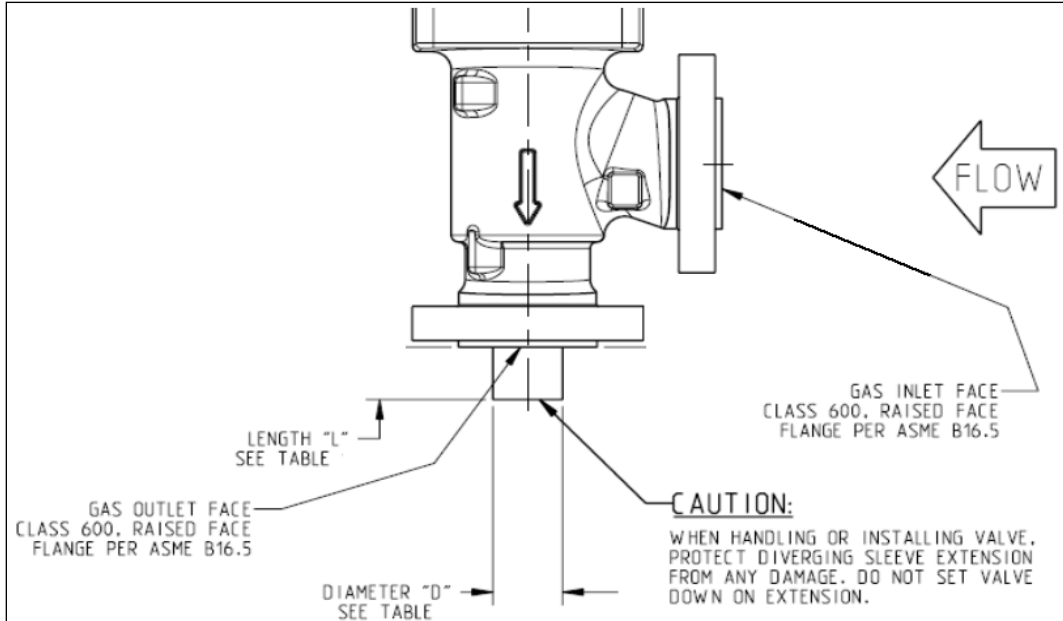


Figure 1-9. Representative Outline Deviation of High Recovery Valves


Table 1-2. Dimensions "L" and "D" per Figure 1-5 for High Recovery LESVs

Valve Size	Dimension "L" (Inches)	Dimension "D" (Inches)	Recovery Factor
2-Inch	1.500	1.670	1.08
3-Inch	3.700	2.620	1.08
4-Inch	5.000	3.250	1.08
6-Inch	7.000	4.500	1.08

Table 1-3. Dimensions "L" and "D" per Figure 1-5 for Ultra High Recovery LESVs

Valve Size	Dimension "L" (Inches)	Dimension "D" (Inches)	Recovery Factor
2-Inch	4.000	1.880	1.06
3-Inch	6.000	2.810	1.06
4-Inch	8.000	3.960	1.06
6-Inch	12.000	5.580	1.06


PIN DEFINITION FOR  
MOTOR SIGNAL CONNECTOR  
(RESOLVER 1)  
M83723/83-G-16-10-N

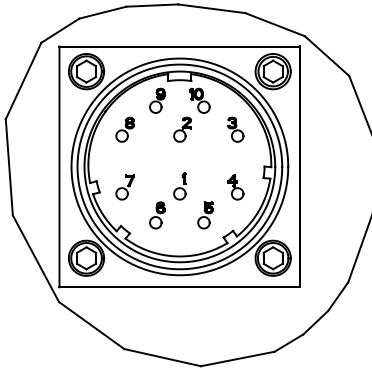

- PIN 1 EXC +
- PIN 2 EXC -
- PIN 3 COS +
- PIN 4 COS -
- PIN 5 SIN +
- PIN 6 SIN -
- PIN 7 SEAL PLUG
- PIN 8 SEAL PLUG
- PIN 9 SEAL PLUG
- PIN 10 SEAL PLUG

DETAIL A  
SCALE 2.000


PIN DEFINITION FOR  
SHAFT RESOLVER CIRCULAR CONNECTOR  
M83723/83-G-18-14-N

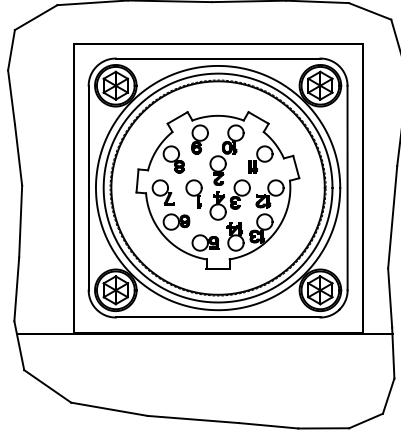

- PIN 1 COS +
- PIN 2 COS -
- PIN 3 SIN +
- PIN 4 SIN -
- PIN 5 EXC +
- PIN 6 EXC -
- PIN 7 POWER
- PIN 8 GROUND
- PIN 9 ID CAN 3 H
- PIN 10 ID CAN 3 L
- PIN 11 SEAL PLUG
- PIN 12 SEAL PLUG
- PIN 13 SEAL PLUG
- PIN 14 SEAL PLUG

DETAIL B  
SCALE 2.000


PIN DEFINITION FOR  
MOTOR POWER CONNECTOR  
M23 POWER CONNECTOR  
RDE CONNECTOR P/N = SF-5EPIN8AAD00-7MP

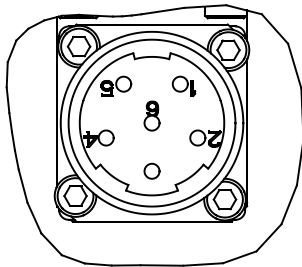

- PIN 1 L1-U
- PIN 2 CHASSIS GRD
- GRD BLANK PIN
- PIN 4 L3-W
- PIN 5 L2-V
- PIN 6 BLANK PIN

DETAIL C  
SCALE 2.000

PIN DEFINITION FOR  
MOTOR SIGNAL CONNECTOR  
(RESOLVER 2)  
M83723/83-G-14-07-N

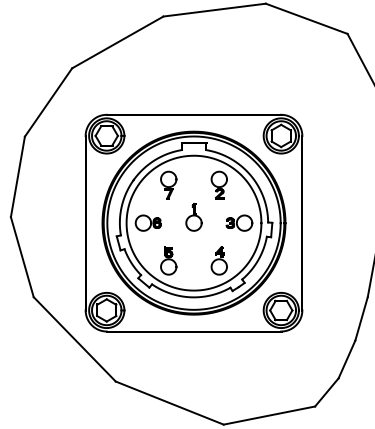

- PIN 1 EXC +
- PIN 2 EXC -
- PIN 3 COS+
- PIN 4 COS -
- PIN 5 SIN+
- PIN 6 SIN-
- PIN 7 SEAL PLUG

DETAIL D  
SCALE 2.000

264-057C  
9999-1339  
10/27/16

Figure 1-10. Connector Pin-outs

## Chapter 2. Description

### Electrical Mechanical Actuator Assembly

The electrical-mechanical actuator consists of a brushless dc motor that provides torque, an integral resolver for motor commutation and position feedback to the controller, a valve stem resolver for motor resolver verification, and a high-efficiency ball screw for rotary-to-linear motion conversion. The actuator also contains a fail-safe spring designed to extend the actuator if power is removed from the actuator.

- A soft-stop spring to dissipate motor rotor inertia during fail-safe shutdown and prevent ball screw damage
- A cam follower to provide opposing torque during slew operations
- A lifting eye to aid installation

### Brushless DC Motor

The motor used on the LESV is a permanent magnet, electrically commutated, brushless dc motor. The components used in the motor are rated for service from  $-40$  to  $+155$  °C ( $-40$  to  $+311$  °F). The motor is a permanently lubricated assembly with a sealed enclosure rating of IP55.

### Resolver Position Feedback Sensors

The primary position feedback transducer is the resolver that is integral to the dc brushless motor. The actuator also has a valve stem resolver. This resolver is used as a watchdog function of the primary motor control, to prevent runaway conditions and to ensure that the primary motor resolver is reading correctly. Linear shaft motion is converted to angular rotation for the valve stem resolver through a linkage. Parameter files are loaded onto the DVP to specifically match the valve characteristics in order to obtain the most accurate position sensing.

### Soft Stop Spring

Integral to the actuator is a soft stop spring. This provides a bumper like action if the actuator is driven hard into the fully extended position. This will occur only on loss of power, certain wiring faults, and in rare cases, internal fault conditions within the positioner. The soft stop mechanism is not used when the positioner is controlling the actuator. Although the positioner will rapidly drive the actuator towards the minimum position, it also decelerates the actuator as the actuator approaches the mechanical minimum stop. Under the control of the positioner, the actuator should not reach the mechanical minimum stop at a high velocity.

### Valve

The SonicFlo contoured plug valve consists of a valve housing, metering plug, diverging sleeve, pilot sleeve/bonnet, and actuator adapter. The metering elements of this valve are a contoured plug and a hardened seat. The plug is contoured to provide various Cg versus position flow characteristics from 0% to 100% stroke. Please contact Woodward for available trim sizes and Cg profiles.

## Chapter 3. Installation

### General

See the outline drawings (Figures 1-1 through 1-4) for:

- Overall dimensions
- Process piping flange locations
- Electrical connections
- Lift points and center of gravity

Installation attitude does not affect actuator or fuel valve performance, but a vertical position is generally preferred to conserve floor space as well as ease of making electrical and fuel connections. The LESV is designed for support by the piping flanges alone; additional supports are neither needed nor recommended. Do not use this valve to provide support to any other component in the system. The piping should be aligned and adequately supported such that excessive piping loads are not transmitted to the valve body.

#### **! WARNING**

**EXPLOSION HAZARD**—The surface temperature of this valve approaches the maximum temperature of the applied process media. It is the responsibility of the user to ensure that the external environment contains no hazardous gases capable of ignition in the range of the process media temperatures.

#### **! WARNING**

Do not operate the valve without proper support for the diverging sleeve. **IF BENCH TESTING THE VALVE, ENSURE THAT ASME/ANSI RATED FLANGES ARE GASKETED AND INSTALLED OVER THE INLET AND DISCHARGE FLANGES WITH THE BOLTS PROPERLY TORQUED.** The diverging sleeve screws by themselves are not designed to hold pressure loads. Failure to comply with this warning may result in personal injury. Do not place hands inside valve body during inspection, cleaning, or operation.



**DIVERGING  
SLEEVE  
SCREWS -  
DO NOT  
PRESSURE  
LOAD!**

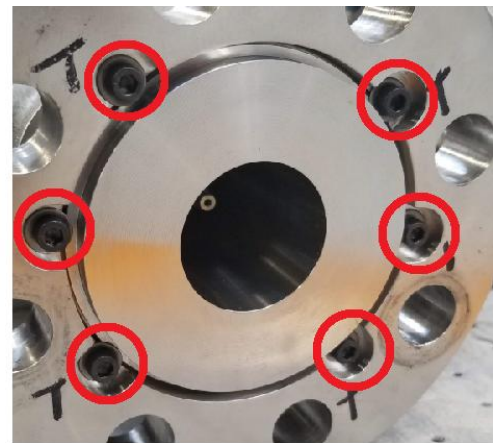


Figure 3-1. Illustration of Diverging Sleeve Screws

Diverging Sleeve assembly screws are not designed to hold pressure loads. If bench testing, do not apply pressure to the valve without ANSI flanges (see below figures).

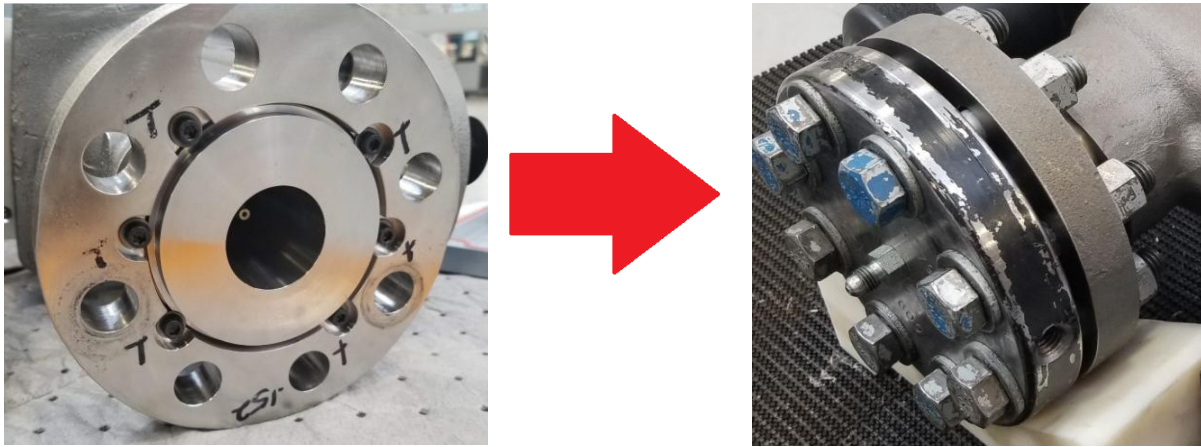


Figure 3-2. Illustration of Raised Face Style Diverging Sleeve

Raised Face style diverging sleeves should be secured with a blind flange when bench testing.

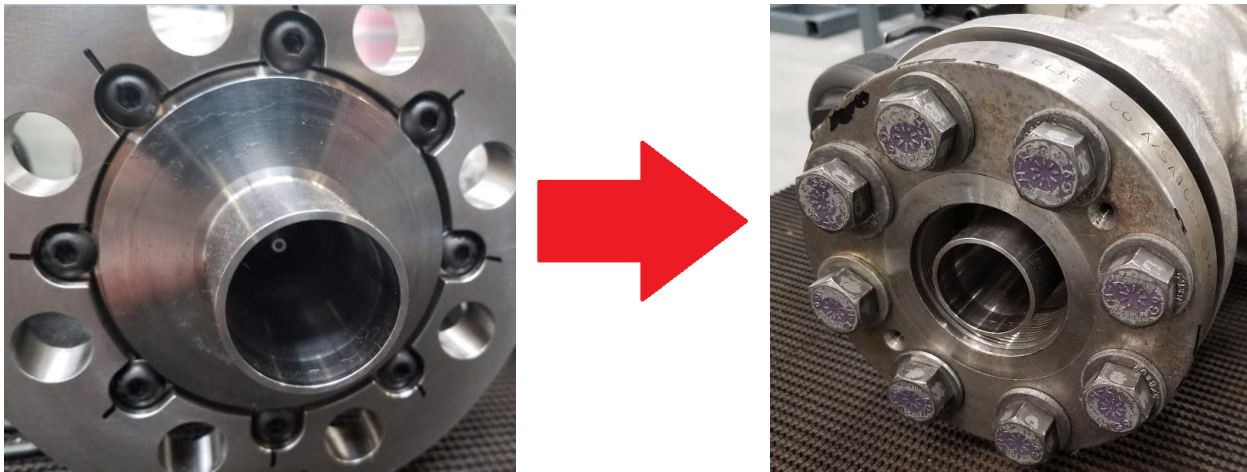


Figure 3-3. Illustration of Extension Style Diverging Sleeve

Extension style diverging sleeves should be secured with a threaded or weld neck style flange when bench testing.

**⚠ WARNING**

Due to typical noise levels in turbine environments, hearing protection should be worn when working on or around the Large Electric Sonic Valve. Noise levels of greater than 90 dB are possible.

**⚠ WARNING**

The surface of this product can become hot enough or cold enough to be a hazard. Use protective gear for product handling in these circumstances. Temperature ratings are included in the specification section of this manual.

**⚠ WARNING**

Lift or handle the valve only by using the eyebolts.

The LESV is not designed to be a step or to support the weight of a person.

**NOTICE**

External fire protection is not provided in the scope of this product. It is the responsibility of the user to satisfy any applicable requirements for their system.

## Piping Installation

Refer to ANSI B16.5 for details of flange, gasket, and bolt types and dimensions. Verify that the process piping face-to-face dimensions meet the requirements of the outline drawings (Figures 1-1 through 1-4) within standard piping tolerances. The valve should mount between the piping interfaces such that the flange bolts can be installed with only manual pressure applied to align the flanges. Mechanical devices such as hydraulic or mechanical jacks, pulleys, chain-falls, or similar equipment should never be used to force the piping system to align with the valve flanges.

ASTM/ASME grade bolts or studs should be used to install the valve into the process piping. The length and diameter of the bolts and studs shall conform to ANSI B16.5 according to the valve flange size and class.

Flange gasket materials should conform to ANSI B16.20. The user should select a gasket material which will withstand the expected bolt loading without injurious crushing, and which is suitable for the service conditions.

When installing the valve into the process piping, it is important to properly torque the studs/bolts in the appropriate sequence in order to keep the flanges of the mating hardware parallel to each other. A two-step torque method is recommended. Once the studs/bolts are hand-tightened, torque the studs/bolts in a crossing pattern to half the required torque. Once all studs/bolts have been torqued to half the appropriate value, repeat the pattern until the rated torque value is obtained.

Do not insulate the valve or actuator. Insulation may be used on the inlet horizontal leg of the pipe. There should be no insulation around the outlet flange of the valve or the outlet riser pipe. If the outlet riser pipe is longer than 6 diameters, insulation may be used below the 6-diameter mark. This is because the purge temperature is extremely hot and may damage the valve seals.

**Note:** The Valve discharge flange must not exceed 277°C (530°F) when the valve is closed and the downstream circuit is being purged.

Piping loads that can be considered “typical” have been used in the design of the housing to ensure that there is not an adverse effect from the stresses applied to the housing from the inlet and outlet piping. The loads which were used in the design of these housings are (and should not be exceeded):

Table 3-1. Piping Loads According to Valve Size

Valve Size	Max Axial Pipe Force	Max Pipe Moment
50 mm (2 inch)	3600 N (809.3 lbs.)	2200 N·m (1622.6 lb-ft)
80 mm (3 inch)	5400 N (1214 lbs.)	3300 N·m (2434 lb-ft)
100 mm (4 inch)	7200 N (1618 lbs)	4400 N·m (3245.3 lb-ft)
150 mm (6 inch)	11000 N (2472.9 lbs)	6600 N·m (4867.9 lb-ft)

## Fuel Overboard Vent Connection

There is a fuel overboard vent port that must be vented to a safe location. In normal operation, this vent should have very low leakage.

**NOTICE**

Never plug the fuel overboard vent port, which could cause the valve to malfunction or to operate improperly.

## Valve Characteristic Data

Flow testing is conducted on every valve before shipment. Results from this flow testing produce Cg versus position characteristics of the valve. Each valve must demonstrate predetermined Cg characteristics before it can be shipped.

## Calibration

The actuator and controller perform an automatic rigging procedure. When the actuator controller is activated, it performs an automatic rigging procedure that checks system health and verifies the valve is in the proper position. No additional steps are required from the operator.

## Valve/Actuator Configuration Settings

The LESV utilizes a device (ID Module) containing all the configuration and calibration information that is read by the Digital Valve Positioner (DVP) when the valve/actuator is connected and powered up. Initial configuration settings for the valve/actuator do not need to be entered into the DVP due to the ID Module communicating directly with the positioner. However, in the unlikely event the configuration settings must be entered manually, the following tables outline the necessary configuration settings for the LESV. These configuration settings are broken up into three groups: User Configuration Parameters, Valve Part Number Specific Parameters, and Valve Serial Number Specific Parameters. Some of the configuration settings include factory calibration information. Please contact Woodward with the valve part number and serial number for the data containing the specific calibration and configuration settings if the need arises. Many of these parameters are accessible via the Woodward Service Tool.

### User Configuration Parameters

The User Configuration Parameters are used in the DVP to define the interface between the DVP and the turbine control system. Examples of these include the demand type selection, analog input scaling, discrete input and output configurations, etc. For a complete description of all the options for the User Configuration Parameters, please see the DVP product manual.

### Valve Part Number Specific Parameters

These parameters define the settings based on a particular valve type (part number). Every valve of the same type, regardless of serial number, will have the same settings. Please refer to the table below for a definition of these settings. For instructions on how to enter these values, please refer to the DVP manual.

**NOTICE**

Please contact Woodward for the correct settings for your application.

Table 3-2. Valve Part Number Specific Parameters

Parameter Name	Description	Value/Units
<b>ValveTypeld.</b>		
IdModuleVersion	Parameter set version	1 = Rev 0 2 = Rev 1, etc.
ValveType	Selects valve type	9 = 1.5" Stroke LESV 10 = 3.0" Stroke LESV 11 = 0.5" Stroke LESV
ValveProductCode	Upper level part number of valve assembly	xxxx-xxxx
ValveProductRev	EC Revision of Valve Assembly	1 = NEW 2 = A 3 = B, etc. 100 = Rev 0 101 = Rev 1, etc.
<b>BLDCPosStateParams.</b>		
MinCheckCurrent	Current to close valve during min startup check	amps
MaxCheckCurrent	Current to preload valve in opening direction during min startup check	amps
MotorDirectioncheckLimit	Min movement in the closing direction during startup check to avoid a motor direction error	% of electrical revolution
<b>SetPosZeroCutOffParams.</b>		
Mode	Turns on or off the zero cut off function	0 = Off 1 = On
LowLimit	Zero cut off will be turned on below this stroke	%
HighLimit	Zero cut off will be turned off above this limit	%
DelayTime	Delay time before zero cut off is turned on	ms
<b>ModelPositionErrParams.</b>		
PosErrMotorAlarmTime	Motor resolver delay time before a position error is flagged as an alarm	sec
PosErrMotorAlarmLimit	Alarm limit for error allowed between the position demand and the motor resolver feedback	%
PosErrMotorShutdownTime	Motor resolver delay time before a position error creates a shutdown	sec
PosErrMotorShutdownLimit	Shutdown limit for error allowed between the position demand and the motor resolver feedback	%
PosErrShaftAlarmTime	Shaft resolver delay time before a position error is flagged as an alarm	sec
PosErrShaftAlarmLimit	Alarm limit for error allowed between the position demand and the shaft resolver feedback	%
PosErrShaftShutdownTime	Shaft resolver delay time before a position error creates a shutdown	sec
PosErrShaftShutdownLimit	Shutdown limit for error allowed between the position demand and the shaft resolver feedback	%

Table 3-2. Valve Part Number Specific Parameters (cont'd.)

Parameter Name	Description	Value/Units
<b>NoiseFilterParams.</b>		
NoiseFilterMode	Selects noise filter mode	
Bandwidth	Input noise filter bandwidth	Hz
Damping	Input noise filter damping	Typical 2 <sup>nd</sup> order response is 1.0
Threshold	Below this threshold the gain setting will be used, above this threshold the gain setting will be set to 1.0	%
Gain	Input noise filter gain	
<b>PaceMakerParams.</b>		
Mode	Turns on or off the pace maker function	0 = Off 1 = On
DelayTime	Delay time between pace maker pulses	min
PositionStep	Position demand magnitude for the pace maker pulse	%
ImpulseHalfDuration	Time pulse remains high, also time pulse remains low	ms

### Valve Serial Number Specific Parameters

Each valve, regardless of valve type or part number, will have a set of unique settings corresponding to the calibration process done on each unit at the factory. Refer to the table below for a definition of these settings. Please contact Woodward in the event these values need to be entered into the DVP.

Table 3-3. Valve Serial Number Specific Parameters

Parameter Name	Description	Value
<b>ValveTypeId.</b>		
ValveSerialNum	Valve assembly serial number	Factory Calibrated
<b>ResolverScalingParams.</b>		
Shaft1Resolver.LelaScaling.Length1	Secondary resolver calibration	Factory Calibrated
Shaft1Resolver.LelaScaling.Length2	Secondary resolver calibration	Factory Calibrated
Shaft1Resolver.LelaScaling.Xoffset	Secondary resolver calibration	Factory Calibrated
Shaft1Resolver.LelaScaling.YatZero	Secondary resolver calibration	Factory Calibrated
Shaft1Resolver.LelaScaling.YatMax	Secondary resolver calibration	Factory Calibrated
Shaft1Resolver.LelaScaling.ROffset	Secondary resolver calibration	Factory Calibrated
Shaft1Resolver.LelaScaling.RRollOver	Secondary resolver calibration	Factory Calibrated
<b>BLDCPosStateParams.</b>		
MinCheckMotorResMin	Startup diagnostic limit	Factory Calibrated
MinCheckMotorResMax	Startup diagnostic limit	Factory Calibrated
MinCheckShaftResMin	Startup diagnostic limit	Factory Calibrated
MinCheckShaftResMax	Startup diagnostic limit	Factory Calibrated
MaxCheckMotorResMin	Startup diagnostic limit	Factory Calibrated
MaxCheckMotorResMax	Startup diagnostic limit	Factory Calibrated
MaxCheckShaftResMin	Startup diagnostic limit	Factory Calibrated
MaxCheckShaftResMax	Startup diagnostic limit	Factory Calibrated
MotorResolverOffset	Startup diagnostic limit	Factory Calibrated
<b>SetPosOffsetParams.Offset</b>	Calibration position offset	Factory Calibrated

## Electrical Connections

**! WARNING**

Due to the hazardous location listings associated with this product, proper wire type and wiring practices are critical to operation.

**NOTICE**

Do not connect any cable grounds to “instrument ground”, “control ground”, or any non-earth ground system. Make all required electrical connections based on the wiring diagrams (Figure 1-6).

**! CAUTION**

For best noise immunity, and to prevent damage to on-board actuator instruments, the motor power cables should be run in separate cable trays or conduits from the motor resolver cables and any other low-level signal cables.

This product is designed for use with three (or four with optional redundant motor resolver) dedicated cables that connect the Digital Valve Positioner to the LESV assembly. These cables must be used for the system to meet all CSA, ATEX, EMC, and LVD requirements. Please contact Woodward for the appropriate cable configuration.

Refer to the outline drawings (Figures 1-1 through 1-4) for location of grounding lug in order to properly earth ground the LESV.

Figures 3-7, 3-8, 3-9, and 3-10 show drawings typical of the four dedicated cables used to connect the LESV valve to the DVP driver. The drawings in these figures include wiring diagrams and connector descriptions. Application specific requirements such as termination at the DVP, length and environmental conditions, etc., may result in a custom implementation of these cables by the customer.

**! WARNING**

Electrical circular connectors must be properly seated and tightened in order to provide correct performance, to eliminate potential shock hazard, and to maintain the LESV's IP rating.

Connect external ground terminal of actuator to the earth ground. This must be the same grounding system as the driver's earth ground.

**! WARNING**

The LESV are to be used only with the Woodward Digital Valve Positioner (DVP).

Wiring must be in accordance with North American Class I, Division 2 or International Zone 2 wiring methods as applicable and in accordance with the authority having jurisdiction.

Firmly seat all electrical connections on the appropriate connector. A seating torque of 22 inch pounds (2.5 N\*m) should be applied to the power connector to ensure proper connection.

## Power Connector

The mating power cable connector shall be installed hand-tight followed by a final torque of 2.5 Nm (22 lb.-in) to meet the IP rating.

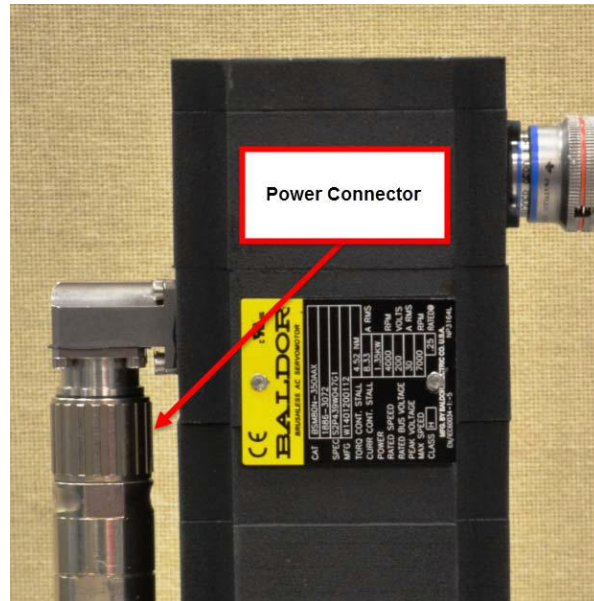


Figure 3-4. Power Connector

**Note:** Actual connector orientation on motor may appear different than that shown.

## Motor Resolver Connectors (Two Resolvers)

Install these two mating cable connectors by hand, so that the red line is no longer visible and the connector cannot be turned any further.

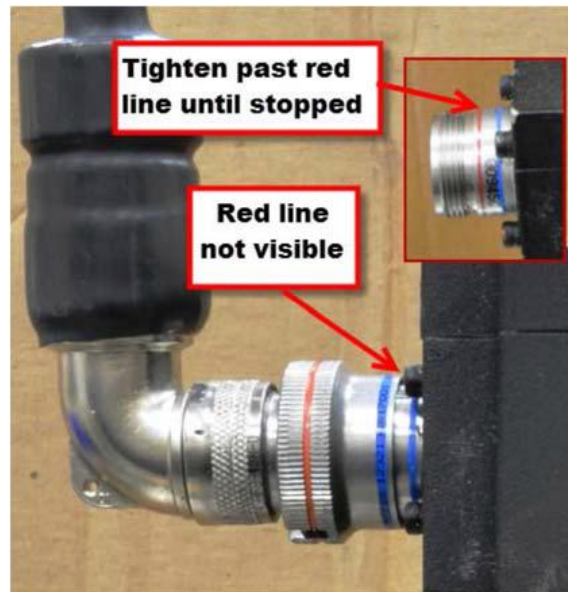


Figure 3-5. Motor Resolver Connectors

### ID Module/Shaft Resolver Actuator Connector

Install the mating cable connector by hand, so that the red line is no longer visible, and the connector cannot be turned any further.

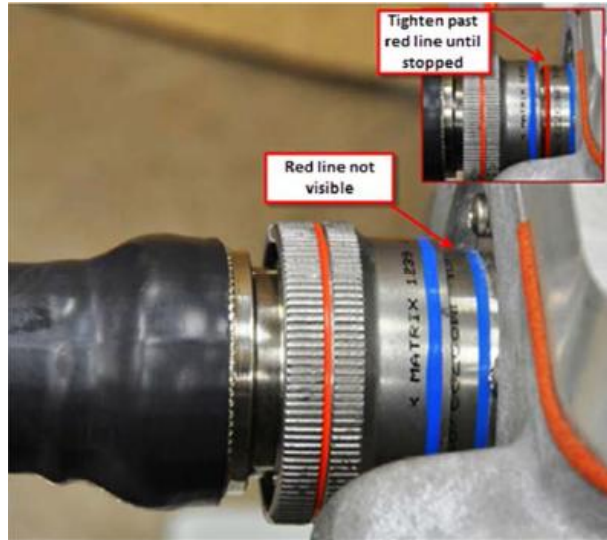


Figure 3-6. ID Module/Shaft Resolver Actuator Connector

**Note:** Actual connector location on actuator may appear different than that shown.

## Preservation and Storage

Woodward products are packaged and shipped to the most stringent industry standards for international shipments. In most cases, Woodward products are constructed with stainless steel and other corrosion resistance materials. Products not manufactured from these materials are provided with a corrosion inhibiting coating to best protect the item under normal conditions.

To maintain the Woodward warranty, items must be stored in a clean, dry environment free of ingress from any foreign debris (including animals, insects, and other organic materials). The preferred method of storage is to keep the product in the “as shipped” containers until the product is installed per the O&M Manual. In the event that this is not possible, each product is shipped with covers to prevent ingress of normal materials to the internals of the product. These shipping covers must not be removed until product is installed per the O&M Manual.


Products for the intended use of containing pressurized fluid of any kind will contain various styles of seals. After extended periods of storage (greater than 12 months), these seals can “take a set” and may allow leakage during the initial use of the product.

Prior to use, Woodward recommends that the product be pressurized and manually stroked over its full stroke for at least five minutes or 100 cycles, whichever occurs first. This cycling will enable the seals to regain their preferred shape and provide optimal sealing for the remainder of the product life.

Products that include electronic components (internal driver or other circuit boards) should be powered at least once every six months. This process will ensure the integrity of the electrical components for the remainder of the product life. Products that include electronic components (internal driver or other circuit boards) should be powered at least once every six months. This process will ensure the integrity of the electrical components for the remainder of the product life.

Following these general recommendations will allow Woodward products to be stored for long periods of time without degradation to the product performance. Please contact a Woodward Representative for more detailed information or for questions based upon specific field conditions. When storing beyond three years it is recommended to return to the factory for recertification as seals can take a set.



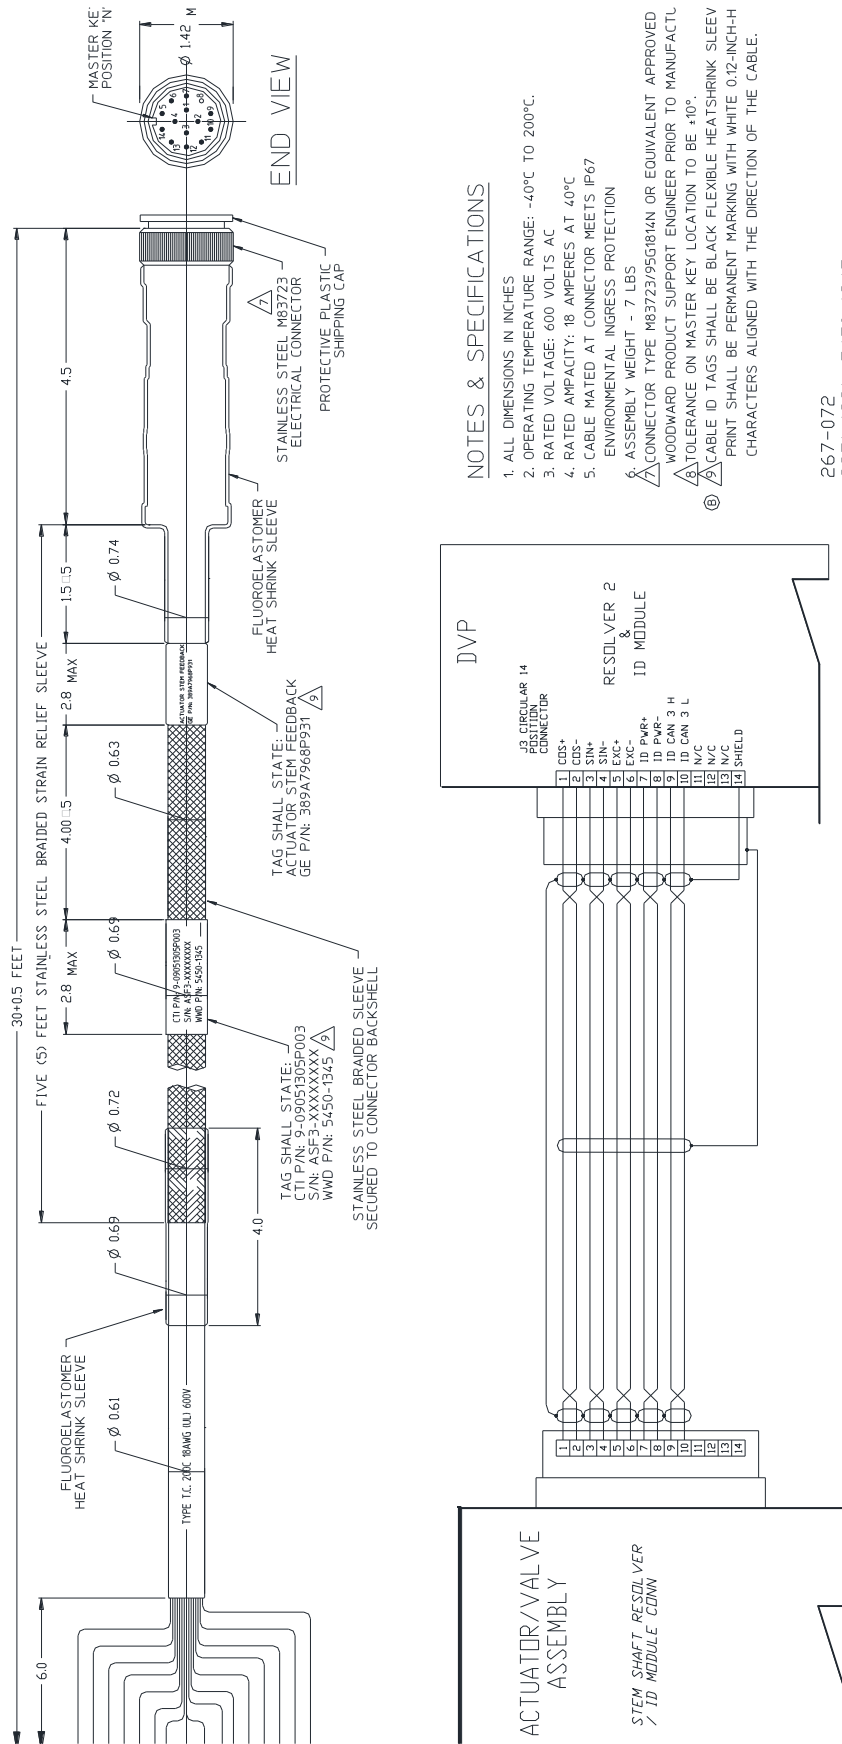


**NOTES & SPECIFICATIONS**

1. ALL DIMENSIONS IN INCHES
2. OPERATING TEMPERATURE RANGE: -40°C TO 200°C.
3. RATED VOLTAGE: 600 VOLTS AC
4. RATED AMPACITY: 18 AMPERES AT 40°C
5. CABLE RATED AT CONNECTOR MEETS IP67 ENVIRONMENTAL INGRESS PROTECTION
6. ASSEMBLY WEIGHT - 7 LBS
7. CONNECTOR TYPE M83723/95G1814N OR EQUIVALENT APPROVED WOODWARD PRODUCT SUPPORT ENGINEER PRIOR TO MANUFACTURE
8. TOLERANCE ON MASTER KEY LOCATION TO BE +10°.
9. CABLE ID TAGS SHALL BE BLACK FLEXIBLE HEATSHRINK SLEEVE PRINT SHALL BE PERMANENT MARKING WITH WHITE 0.12-INCH-H CHARACTERS ALIGNED WITH THE DIRECTION OF THE CABLE.

267-072  
9971-1281, 5450-1345  
7/2015

Figure 3-8. Cable, Stem Shaft Resolver, Feedback Signal

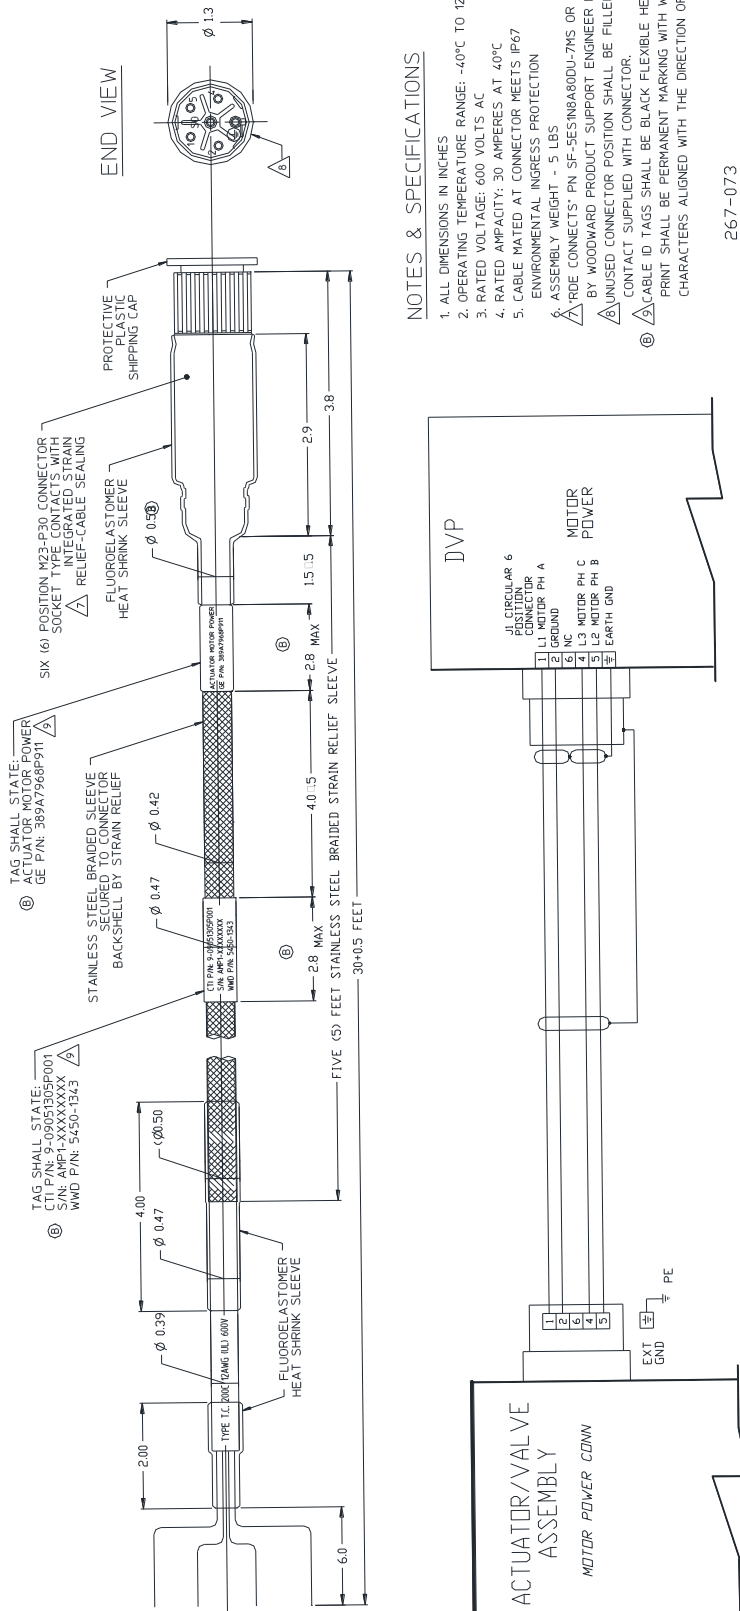

NOTES & SPECIFICATIONS

1. ALL DIMENSIONS IN INCHES
2. OPERATING TEMPERATURE RANGE: -40°C TO 125°C.
3. RATED VOLTAGE: 600 VOLTS AC
4. RATED AMPACITY: 30 AMPERES AT 40°C
5. CABLE MATED AT CONNECTOR MEETS IP67 ENVIRONMENTAL INGRESS PROTECTION
6. ASSEMBLY WEIGHT - 5 LBS
7. WIRE CONNECTS: PN SF-SESINBA800U-7MS OR EQUIVALENT APPROPRIATE BY WOODWARD PRODUCT SUPPORT ENGINEER PRIOR TO MANUFACTURE
8. UNUSED CONNECTOR POSITION SHALL BE FILLED WITH CONTACT SUPPLIED WITH CONNECTOR.
9. CABLE ID TAGS SHALL BE BLACK FLEXIBLE HEATSHRINK SLEEVE PRINT SHALL BE PERMANENT MARKING WITH WHITE 0.12-INCH-HIGH CHARACTERS ALIGNED WITH THE DIRECTION OF THE CABLE.

267-073  
9971-1281, 5450-1343  
7/2015

Figure 3-9. Cable, Motor Power

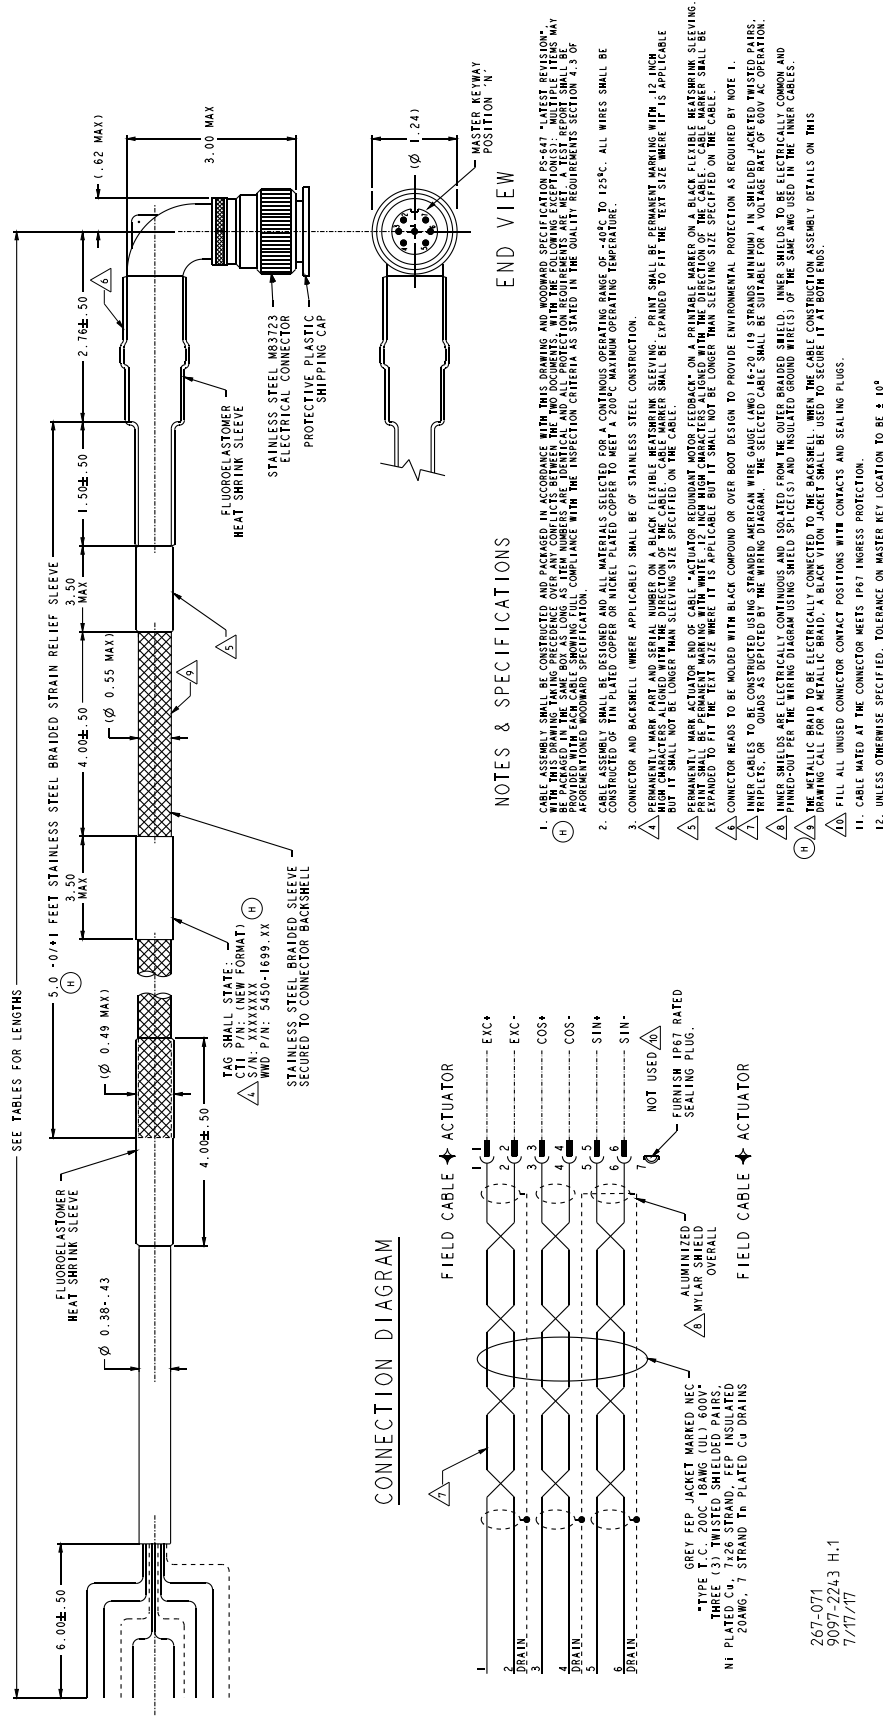


Figure 3-10. Cable, Motor Resolver 2, Feedback Signal

# Chapter 4.

## Maintenance and Hardware Replacement

### Maintenance

The only maintenance required for the Large Electric Sonic Valve is lubricating the ball screw and bearing and inspecting the fuel overboard vent port every 12 months, in accordance with the descriptions below.

The LESV is not designed with field-replaceable components. Contact the turbine manufacturer (primary contact) or Woodward (secondary contact) for assistance in the event there is a problem requiring service or replacement.

### Hardware Replacement

**! WARNING**

**EXPLOSION HAZARD**—Substitution of components may impair suitability for Class I, Division 2 or Zone 2.

**! WARNING**

To prevent possible serious personal injury, or damage to equipment, be sure all electric power, hydraulic pressure, and gas pressure have been removed from the valve and actuator before beginning any maintenance or repairs.

**! WARNING**

Lift or handle the valve only by using the eyebolts.

**! WARNING**

Due to typical noise levels in turbine environments, hearing protection should be worn when working on or around the Large Electric Sonic Valve. Noise levels of greater than 90 dB are possible.

**! WARNING**

The surface of this product can become hot enough or cold enough to be a hazard. Use protective gear for product handling in these circumstances. Temperature ratings are included in the specification section of this manual.

**! WARNING**

The LESV contains a mechanical spring under load. Do not disassemble, as this spring can cause bodily harm.

**NOTICE**

Use only Woodward-approved grease to lubricate the ball screw and bearing in this actuator. Use of any other grease will reduce performance and reliability. Woodward lubrication kits are available as part number 8923-1186.

## Ball Screw Lubrication Procedure



Wear rubber gloves in order to avoid contact with the grease during the lubrication procedure.

### Lubricating the Ball Screw Assembly

1. Clean the outside of the actuator to ensure that no debris gets inside the actuator during the lubrication process. Any debris on the ball screw will reduce its life.
2. Remove the ball screw access plug located on the top of the gear cover with a 5/16 inch hex wrench (Figure 4-1).
3. Remove the ball screw port plug with a 3/16 inch hex wrench (Figure 4-2).
4. Set the ball screw access and port plugs aside and keep clean, ensuring that they are not scratched or marred.
5. Attach the thread connector of the grease syringe to the threaded grease port of the ball screw. The fitting should be fully seated (Figure 4-3).
6. Inject 2 cm<sup>3</sup> of Woodward approved grease (8923-1186) into the ball screw grease port.
7. Remove the grease syringe from the ball screw grease port and install the ball screw port plug. Do not torque the port plug (Figure 4-4).
8. Remove the plug that is adjacent to the ball screw port, set aside, and keep clean, ensuring that the plug is not scratched or marred (Figure 4-5).
9. Using a permanent marker or tape, mark a 5/32 inch Allen wrench at 2.75 inches from the bottom. Make sure the top of the marking is at 2.75 inches (Figure 4-6).
10. Insert the Allen wrench into the port located adjacent to the ball screw port. The Allen wrench is seated if the marking is below the top surface of the gear cover (Figure 4-7).
11. If the Allen wrench is not seated, rotate the gears using a 3/16 inch hex wrench on the ball screw port plug and rotate clockwise until the 5/32 inch Allen wrench is seated.
12. Once the 5/32 inch Allen wrench is seated, torque the ball screw port plug to 38–42 lb.-in (4.3–4.7 Nm) (Figure 4-8).
13. Remove the 5/32 inch Allen wrench from the port, install the plug into the port located adjacent to the ball screw port, and torque to 38–42 lb.-in (4.3–4.7 Nm) (Figure 4-9).
14. Install the ball screw access plug and torque to 145–155 lb.-in (16.4–17.5 Nm) (Figure 4-10).



Figure 4-1



Figure 4-2

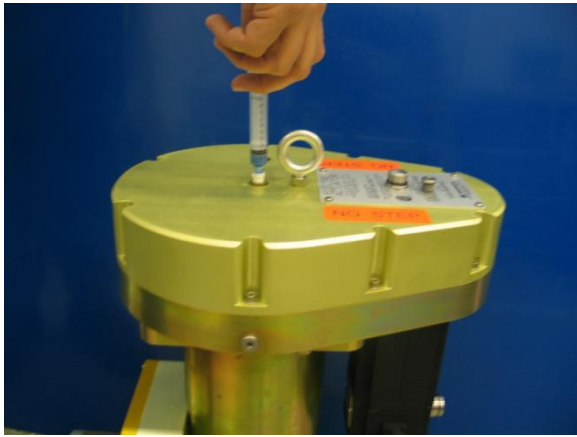


Figure 4-3



Figure 4-4



Figure 4-5

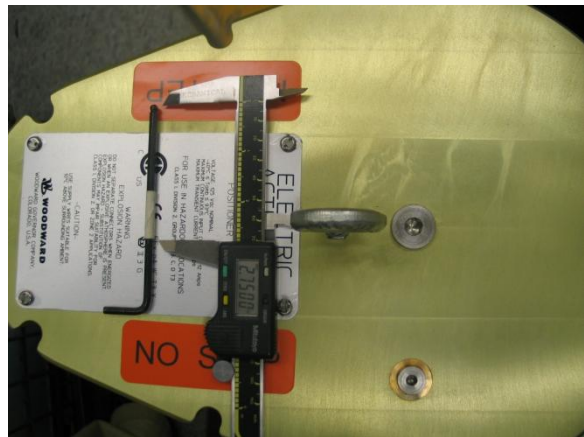


Figure 4-6



Figure 4-7



Figure 4-8

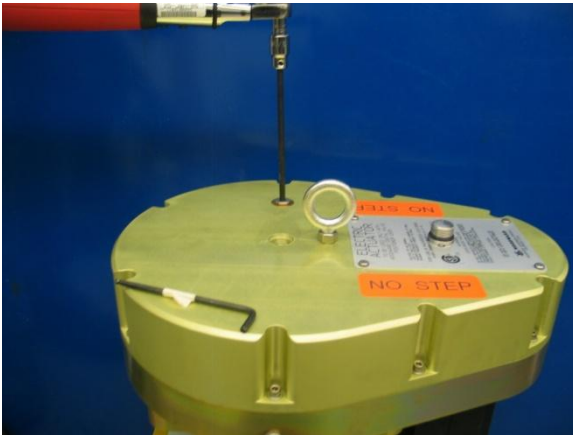


Figure 4-9



Figure 4-10

## Bearing Lubrication Procedure

### Lubricating the Bearing Assembly

1. Clean the outside of the actuator to ensure that no debris gets inside the actuator during the lubrication process. Any debris in the bearing will reduce its life.
2. Remove the bearing port plug with a 3/16 inch hex wrench (Figure 4-11).  
**Note:** Some actuator models have bearing port plugs on both sides of the gearbox housing to allow for access from either side. For these models, the following greasing procedure only needs to be performed on one grease port. Leave the plug installed in the other port that is not being greased.
3. Set the plug aside and keep clean, ensuring that the inside plug surface is not scratched or marred.
4. Attach the thread connector of the grease syringe to the threaded bearing grease port. The fitting should be fully seated (Figure 4-12).
5. Inject 2 cm<sup>3</sup> of Woodward approved grease (8923-1186) into the bearing grease port.
6. Remove the grease syringe from the bearing port and install the bearing port plug. Torque to 38–42 lb.-in (4.3–4.7 Nm) (Figure 4-13).

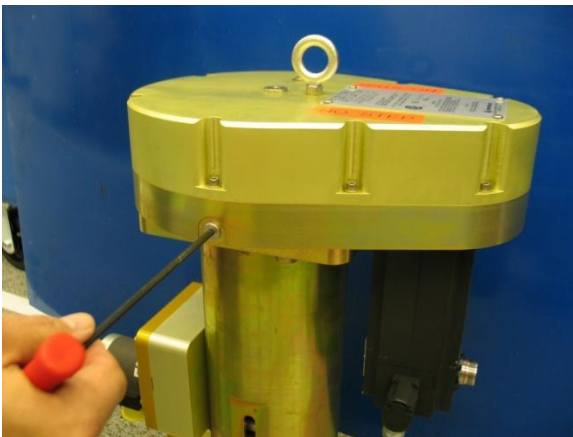


Figure 4-11



Figure 4-12



Figure 4-13

## Fuel Overboard Vent Port

There is a fuel overboard vent port that must be vented to a safe location. In normal operation, this vent should have very low leakage. However, if excessive leakage is detected from this vent port, contact a Woodward representative for assistance.

### **NOTICE**

**Never plug the fuel overboard vent port, which could cause the valve to malfunction or to operate improperly.**

### Fuel Overboard Vent Port Annual Inspections

Pressurize the valve section of the assembly to the rated pressure of 3447 kPa (50 psig) and perform the following inspections:

- Inspect external sealing surfaces for leakage using leak detect fluid (no leakage is permitted). These locations include the inlet and discharge flange connections, as well as the pilot sleeve/valve body interface.
- Inspect for excessive overboard vent leakage (100 cm<sup>3</sup>/min maximum / 6.1 in<sup>3</sup>/min) from the Fuel Overboard Vent Port.

## Chapter 5. Troubleshooting

Faults in the fuel control or governing system are often associated with speed variations of the prime mover, but such speed variations do not always indicate fuel control or governing system faults. Therefore, when improper speed variations occur, check all components, including the engine or turbine, for proper operation. Refer to the applicable electronic control manuals for assistance in isolating the trouble. The following steps describe troubleshooting for the gas fuel control valve.

Disassembly of the Large Electric Sonic Valve in the field is not recommended due to the dangerous forces contained in the springs. Under unusual circumstances, where disassembly becomes necessary, all work and adjustments should be made by personnel thoroughly trained in the proper procedures. When inspecting the valve for suspected blockages, remove the valve from the fuel system and only inspect with the unit powered off.



**WARNING**

The LESV contains a mechanical spring under load. Do not disassemble, as this spring can cause bodily harm.



**WARNING**

When inspecting the valve internally through the flanges for potential blockages, remove the valve from the fuel system and ensure that all power and electrical cables are disconnected. Never place hands inside the valve without ensuring that power is disconnected and the position indicator shows the valve is at the closed position.



**WARNING**

Do not operate the valve without proper support for the diverging sleeve. The diverging sleeve can only be properly supported by bolting and by properly torquing the outlet flange to either piping or an equivalent flange. Do not place hands inside the valve body during inspection, cleaning, or operation.

**Note:** When requesting information or service help from Woodward, it is important to include the part number and serial number of the valve assembly in your communication.

Table 5-1. Troubleshooting Symptom, Cause, and Remedy

Symptom	Possible Causes	Remedies
Valve will not open because the DVP will not reset	Motor wires not properly connected between DVP and actuator	Conduct continuity check.
	Resolver wires not properly connected between DVP and actuator	Conduct continuity check.
DVP will reset but valve will not open	Resolver sine wires high and low are flipped	Conduct continuity check.
	Resolver cosine wires high and low are flipped	Conduct continuity check.
	Resolver sine and cosine wires are swapped	Conduct continuity check.

Table 5-1. Troubleshooting Symptom, Cause, and Remedy (cont'd.)

Symptom	Possible Causes	Remedies
Upon enabling, valve will open and then fail closed	Resolver sine and cosine wires are swapped, and sine wires high and low are flipped.	Conduct continuity check.
	Resolver sine and cosine wires are swapped, and cosine wires high and low are flipped.	Conduct continuity check.
Poor flow accuracy	Characterization data in engine control does not match the valve.	Verify characterization data matches the valve serial number.
	Build-up of contamination on the seat.	Remove valve and inspect flow elements.
Poor position stability	One motor wire disconnected.	Conduct continuity check.
Valve stem resolver indicates position error	Incorrect parameter file loaded.	Verify the parameter file matches the valve serial number.
	Valve stem resolver wires not properly connected between DVP and actuator.	Contact manufacture for instructions or return to manufacturer for repair.
	Faulty resolver.	Return to manufacturer for repair.
	Drive train failure.	Return to manufacturer for repair.
High overboard vent leakage	Internal seals damaged.	Return to manufacturer for repair.
High seat leakage	Damage to valve seat or plug.	Remove valve and inspect flow elements. Return to manufacturer for repair.
	Contamination buildup in seat or plug.	Remove valve and inspect flow elements. Return to manufacturer for repair.
	Valve not fully closed.	Remove valve and verify plug is not properly seated. Return to manufacturer for repair.
External gas fuel leakage	Piping flange gaskets missing or deteriorated.	Replace gaskets.
	Piping flanges improperly aligned.	Rework piping as needed to achieve alignment requirements detailed in Chapter 3.
	Piping flange bolts improperly torqued.	Rework bolts as needed to achieve torque requirements detailed in Chapter 3.
	Packing missing or deteriorated.	Return actuator to Woodward for service.

# Chapter 6. Safety Management – Safe Position Fuel Shutoff Function

## Product Variations Certified

The SIL rated LESV for fuel shutoff is designed and certified to the functional safety standards according to IEC61508, Parts 1 through 7. Reference the product FMEDA: WOO 10-11-064 R001 V1R3, and Certification: WOO 1405129 C001.

The functional safety requirement in this chapter applies to all LESVs. The SIL rated LESVs will have a DU FIT of less than 953 FITS for Close to Trip Full Stroke.

The LESV is certified for use in applications up to SIL 3 according to IEC61508.

The LESV is designed and verified to withstand the worst-case (or greater) expected environmental conditions as listed in other sections of this manual.

## Covered LESV Versions

All LESVs are SIL certified for the shutoff function.

## SFF (Safe Failure Fraction) for the LESV – Over Speed SIF

The LESV is only one part of a shutoff system that supports an over-speed shutdown SIF (Safety Instrumented Function). This system consists of a speed sensor, a processing unit and a fuel shutoff actuation sub-system of which the LESV is a component.

The SFF (Safe Failure Fraction) for each subsystem should be calculated. The SFF summarizes the fraction of failures which lead to a safe state plus the fraction of failures which will be detected by diagnostic measures and lead to a defined safety action. This is reflected in the following formulas for SFF:

$$SFF = \lambda_{SD} + \lambda_{SU} + \lambda_{DD} / \lambda_{TOTAL}$$

$$\text{Where } \lambda_{TOTAL} = \lambda_{SD} + \lambda_{SU} + \lambda_{DD} + \lambda_{DU}$$

The failure rates listed below, for only the LESV, do not include failures due to wear-out of any components. They reflect random failures and include failures due to external events such as unexpected use. Reference the FMEDA: WOO 10-11-064 R001 V1R3 for detailed information concerning the SFF and PDF.

Table 6-1. Failure Rates according to IEC61508 in FIT

Device	$\lambda_{SD}$	$\lambda_{SU}$	$\lambda_{DD}$	$\lambda_{DU}$
Full Stroke	0	136	0	953
Full Stroke with PVST	136	0	343	610

According to IEC 61508 the architectural constraints of an element must be determined. This can be done by following the 1H approach according to 7.4.4.2 of IEC 61508 or the 2H approach according to 7.4.4.3 of IEC 61508. The 1H approach should be used for the LESV.

## Response Time Data

The LESV full stroke response time is 1 second maximum from 100% position to fully close.

## Limitations

When proper installation, maintenance, proof testing, and environmental limitations are observed, the useful life of the LESV is 15 years. The LESV can be refurbished, and a product life of 30 years can be achieved.

## Management of Functional Safety

The LESV is intended for use according to the requirements of a safety lifecycle management process such as IEC61508 or IEC61511. The safety performance numbers in this chapter can be used for the evaluation of the overall safety lifecycle.

## Restrictions

The user must complete a full functional check of the LESV after initial installation, and after any modification of the overall safety system. No modification shall be made to the LESV unless directed by Woodward. This functional check should include as much of the safety system as possible, such as sensors, transmitters, actuators, and trip blocks. The results of any functional check shall be recorded for future review.

The LESV must be used within the published specification in this manual.

## Competence of Personnel

All personnel involved in the installation and maintenance of the LESV must have appropriate training. Training and guidance materials are included in this manual.

These personnel shall report back to Woodward any failures detected during operation that may impact functional safety.

## Operation and Maintenance Practice

A periodic proof (functional) test of the LESV is required to verify that any dangerous faults not detected by safety controller internal run-time diagnostics are detected. More information is in the "Proof Test" section below. The frequency of the proof test is determined by the overall safety system design, of which the LESV is part of the safety system. The safety numbers are given in the following sections to help the system integrator determine the appropriate test interval.

The LESV requires no special tools for operation or maintenance of the LESV.

## Installation and Site Acceptance Testing

Installation and use of the LESV must conform to the guidelines and restrictions included in this manual. No other information is needed for installation, programming, and maintenance.

## Functional Testing after Initial Installation

A functional test of the LESV is required prior to use in a safety system. This should be done as part of the overall safety system installation check and should include all I/O interfaces to and from the LESV. For guidance on the functional test, see the Proof Test procedure below.

## Functional Testing after Changes

A functional test of the LESV is required after making any changes that affect the safety system. Although there are functions in the LESV that are not directly safety related, it is recommended that a functional test be performed after any change.

### Proof Test (Functional Test)

The LESV must be periodically proof tested to ensure there are no dangerous faults present that are not detected by on-line diagnostics. This proof test should be performed at least once per year.

### Suggested Proof Test

The suggested proof test consists of a full stroke of the valve, shown in the table below.

Table 6-2. Suggested Proof Test

Step	Action
1	Bypass the safety function and take appropriate action to avoid a false trip.
2	Interrupt or change the signal/supply to the actuator to force the actuator and valve to the Fail-Safe state and confirm that the Safe State was achieved and within the correct time.
3	Re-store the supply/signal to the actuator and inspect for any visible damage or contamination and confirm that the normal operating state was achieved.
4	Inspect the valve for any leaks, visible damage or contamination.
5	Remove the bypass and otherwise restore normal operation.

For the test to be effective the movement of the valve must be confirmed. To confirm the effectiveness of the test both the travel of the valve and slew rate must be monitored and compared to expected results to validate the testing.

### Proof Test Coverage

The Proof Test Coverage for the LESV is given in the table below.

Table 6-3. Proof Test Coverage

Application	Safety Function	$\lambda_{DUPT}^6$	Proof Test Coverage	
			No PVST	with PVST
Clean Service	Close on Trip – Full Stroke	394	59%	35%

The suggested proof test and proof test coverage is referenced in the product FMEDA; WOO Q10-11-064 R001 V1R3.

# Chapter 7.

## Product Support and Service Options

### Product Support Options

If you are experiencing problems with the installation, or unsatisfactory performance of a Woodward product, the following options are available:

- Consult the troubleshooting guide in the manual.
- Contact the manufacturer or packager of your system.
- Contact the Woodward Full Service Distributor serving your area.
- Contact Woodward technical assistance (see “How to Contact Woodward” later in this chapter) and discuss your problem. In many cases, your problem can be resolved over the phone. If not, you can select which course of action to pursue based on the available services listed in this chapter.

**OEM or Packager Support:** Many Woodward controls and control devices are installed into the equipment system and programmed by an Original Equipment Manufacturer (OEM) or Equipment Packager at their factory. In some cases, the programming is password-protected by the OEM or packager, and they are the best source for product service and support. Warranty service for Woodward products shipped with an equipment system should also be handled through the OEM or Packager. Please review your equipment system documentation for details.

**Woodward Business Partner Support:** Woodward works with and supports a global network of independent business partners whose mission is to serve the users of Woodward controls, as described here:

- A **Full Service Distributor** has the primary responsibility for sales, service, system integration solutions, technical desk support, and aftermarket marketing of standard Woodward products within a specific geographic area and market segment.
- An **Authorized Independent Service Facility (AISF)** provides authorized service that includes repairs, repair parts, and warranty service on Woodward's behalf. Service (not new unit sales) is an AISF's primary mission.

A current list of Woodward Business Partners is available at:

<https://www.woodward.com/en/support/industrial/service-and-spare-parts/find-a-local-partner>

### Product Service Options

The following factory options for servicing Woodward products are available through your local Full-Service Distributor or the OEM or Packager of the equipment system, based on the standard Woodward Product and Service Warranty (Woodward North American Terms and Conditions of Sale 5-09-0690) that is in effect at the time the product is originally shipped from Woodward or a service is performed:

- Replacement/Exchange (24-hour service)
- Flat Rate Repair
- Flat Rate Remanufacture

**Replacement/Exchange:** Replacement/Exchange is a premium program designed for the user who is in need of immediate service. It allows you to request and receive a like-new replacement unit in minimum time (usually within 24 hours of the request), providing a suitable unit is available at the time of the request, thereby minimizing costly downtime. This is a flat-rate program and includes the full standard Woodward product warranty (Woodward North American Terms and Conditions of Sale 5-09-0690).

This option allows you to call your Full-Service Distributor in the event of an unexpected outage, or in advance of a scheduled outage, to request a replacement control unit. If the unit is available at the time of the call, it can usually be shipped out within 24 hours. You replace your field control unit with the like-new replacement and return the field unit to the Full-Service Distributor.

Charges for the Replacement/Exchange service are based on a flat rate plus shipping expenses. You are invoiced the flat rate replacement/exchange charge plus a core charge at the time the replacement unit is shipped. If the core (field unit) is returned within 60 days, a credit for the core charge will be issued.

**Flat Rate Repair:** Flat Rate Repair is available for the majority of standard products in the field. This program offers you repair service for your products with the advantage of knowing in advance what the cost will be. All repair work carries the standard Woodward service warranty (Woodward North American Terms and Conditions of Sale 5-09-0690) on replaced parts and labor.

**Flat Rate Remanufacture:** Flat Rate Remanufacture is very similar to the Flat Rate Repair option with the exception that the unit will be returned to you in "like-new" condition and carry with it the full standard Woodward product warranty (Woodward North American Terms and Conditions of Sale 5-09-0690). This option is applicable to mechanical products only.

## Returning Equipment for Repair

If a control (or any part of an electronic control) is to be returned for repair, please contact your Full-Service Distributor in advance to obtain Return Authorization and shipping instructions.

When shipping the item(s), attach a tag with the following information:

- Return authorization number
- Name and location where the control is installed
- Name and phone number of contact person
- Complete Woodward part number(s) and serial number(s)
- Description of the problem
- Instructions describing the desired type of repair

### Packing a Control

Use the following materials when returning a complete control:

- Protective caps on any connectors
- Antistatic protective bags on all electronic modules
- Packing materials that will not damage the surface of the unit
- At least 100 mm (4 inches) of tightly packed, industry-approved packing material
- A packing carton with double walls
- A strong tape around the outside of the carton for increased strength

### **NOTICE**

To prevent damage to electronic components caused by improper handling, read and observe the precautions in Woodward manual 82715, *Guide for Handling and Protection of Electronic Controls, Printed Circuit Boards, and Modules*.

## Replacement Parts

When ordering replacement parts for controls, include the following information:

- The part number(s) (XXXX-XXXX) that is on the enclosure nameplate
- The unit serial number, which is also on the nameplate

## Engineering Services

Woodward offers various Engineering Services for our products. For these services, you can contact us by telephone, by email, or through the Woodward website.

- Technical Support
- Product Training
- Field Service

**Technical Support** is available from your equipment system supplier, your local Full-Service Distributor, or from many of Woodward's worldwide locations, depending upon the product and application. This service can assist you with technical questions or problem solving during the normal business hours of the Woodward location you contact. Emergency assistance is also available during non-business hours by phoning Woodward and stating the urgency of your problem.

**Product Training** is available as standard classes at many of our worldwide locations. We also offer customized classes, which can be tailored to your needs and can be held at one of our locations or at your site. This training, conducted by experienced personnel, will assure that you will be able to maintain system reliability and availability.

**Field Service** engineering on-site support is available, depending on the product and location, from many of our worldwide locations or from one of our Full-Service Distributors. The field engineers are experienced both on Woodward products as well as on much of the non-Woodward equipment with which our products interface.

For information on these services, please contact one of the Full-Service Distributors listed at:

<https://www.woodward.com/en/support/industrial/service-and-spare-parts/find-a-local-partner>

## Contacting Woodward's Support Organization

For the name of your nearest Woodward Full-Service Distributor or service facility, please consult our worldwide directory at <https://www.woodward.com/support>, which also contains the most current product support and contact information.

You can also contact the Woodward Customer Service Department at one of the following Woodward facilities to obtain the address and phone number of the nearest facility at which you can receive information and service.

<b>Products Used in Electrical Power Systems</b>	
<u>Facility</u>	<u>Phone Number</u>
Brazil	+55 (19) 3708 4800
China	+86 (512) 8818 5515
Germany	+49 (711) 78954-510
India	+91 (124) 4399500
Japan	+81 (43) 213-2191
Korea	+82 (51) 636-7080
Poland	+48 (12) 295 13 00
United States	+1 (970) 482-5811

<b>Products Used in Engine Systems</b>	
<u>Facility</u>	<u>Phone Number</u>
Brazil	+55 (19) 3708 4800
China	+86 (512) 8818 5515
Germany	+49 (711) 78954-510
India	+91 (124) 4399500
Japan	+81 (43) 213-2191
Korea	+82 (51) 636-7080
United States	+1 (970) 482-5811

<b>Products Used in Industrial Turbomachinery Systems</b>	
<u>Facility</u>	<u>Phone Number</u>
Brazil	+55 (19) 3708 4800
China	+86 (512) 8818 5515
India	+91 (124) 4399500
Japan	+81 (43) 213-2191
Korea	+ 82 (51) 636-7080
Poland	+48 (12) 295 13 00
United States	+1 (970) 482-5811

## Technical Assistance

If you need to contact technical assistance, you will need to provide the following information. Please write it down here before contacting the Engine OEM, the Packager, a Woodward Business Partner, or the Woodward factory:

### General

Your Name \_\_\_\_\_

Site Location \_\_\_\_\_

Phone Number \_\_\_\_\_

Fax Number \_\_\_\_\_

### Prime Mover Information

Manufacturer \_\_\_\_\_

Turbine Model Number \_\_\_\_\_

Type of Fuel (gas, steam, etc.) \_\_\_\_\_

Power Output Rating \_\_\_\_\_

Application (power generation, marine, etc.) \_\_\_\_\_

### Control/Governor Information

#### Control/Governor #1

Woodward Part Number & Rev. Letter \_\_\_\_\_

Control Description or Governor Type \_\_\_\_\_

Serial Number \_\_\_\_\_

#### Control/Governor #2

Woodward Part Number & Rev. Letter \_\_\_\_\_

Control Description or Governor Type \_\_\_\_\_

Serial Number \_\_\_\_\_

#### Control/Governor #3

Woodward Part Number & Rev. Letter \_\_\_\_\_

Control Description or Governor Type \_\_\_\_\_

Serial Number \_\_\_\_\_

### Symptoms

Description \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

*If you have an electronic or programmable control, please have the adjustment setting positions or the menu settings written down and with you at the time of the call.*

# Revision History

**Changes in Revision AG—**

- Edited ATEX and IECEx compliance
- Updated DoC

**Changes in Revision AF—**

- Replaced EU DoC

**Changes in Revision AE—**

- Added recommendations on corrosive fuels in Chapter 1
- Corrected the rated pressure under Fuel Overboard Vent Port section in Chapter 4

**Changes in Revision AD—**

- Added Caution statement regarding cable separation under Electrical Connections in Chapter 3

**Changes in Revision AC—**

- Added INMETRO Certification to Regulatory Compliance
- Revised SIL Compliance

**Changes in Revision AB—**

- Removed CE line under Pressure Equipment Directive
- Updated EU DoC

**Changes in Revision AA—**

- Revisions to the Regulatory Compliance section
- Replaced DoC

**Changes in Revision Y—**

- Added Korean Certification to Regulatory Compliance section
- Added a Preservation and Storage section to Chapter 3

**Changes in Revision W—**

- Updated Pressure Equipment Declaration in Regulatory Compliance section:
- Replaced DoC

**Changes in Revision V—**

- In Regulatory Compliance section:
  - Updated Pressure Equipment Declaration
  - Updated ATEX – Potentially Explosive Atmospheres Directive
  - Added RoHS Directive
  - Updated ATEX European Directive
- Replaced Declarations

**Changes in Revision U—**

- Replaced Warning on Page 28 regarding Bench Testing
- Added Figures 3-1, 3-2, and 3-3 as examples to illustrate the warning on Bench Testing

**Changes in Revision T—**

- Added content concerning connectors to the Electrical Connections section of Chapter 3
- Added content regarding piping loads and Table 3-1 to the Piping Installation section of Chapter 3
- Added notes clarifying dual lube port models in Chapter 4

**Changes in Revision R—**

- Removed cutaway drawing in Chapter 2
- Updated Cable drawings in Figures 3-1 and 3-4

**Changes in Revision P—**

- Deleted the Low Voltage Directive section
- Updated EMC directive, Pressure Equipment directive, and ATEX section
- Updated Max Fluid Temperature, and Max Fluid/Proof Test Pressures in Table 1-1
- Replaced DOC and DOI

**Changes in Revision N—**

- “SIL Certified” added to the title.
- Removed GOST R Certification from the Regulatory Compliance chapter
- Added an “Other International Compliance:” section to the Regulatory Compliance chapter and added IECEx for the LELA Actuator
- Added an “EAC Customs Union:” section to the Regulatory Compliance chapter
- Added SIL Compliance section to the Regulatory Compliance chapter
- Added Ultra High Recovery valve specification in Chapter 1
- Added new Class 600 valve specifications in Chapter 1
- Added Class 600 engineering drawings in Chapter 1
- New 3-Inch Dimension “L” in Table 1-1 in Chapter 1
- Added Table 1-2 for ultra-high recovery valves to Chapter 1
- Deleted bolt size and torque table from Chapter 3
- Added new paragraph at the end of Piping Installation section in Chapter 3
- Added new cable drawings in Chapter 3
- Revised electrical connection drawings in Chapter 3
- Added Chapter 6, Safety Management – Safe Position Fuel Shutoff Function

**Changes in Revision M—**


- Updated Class 600 proof test pressure (page 10)

**Changes in Revision L—**

- Updated Regulatory Compliance information and Declarations

# Declarations


## EU DECLARATION OF CONFORMITY

**EU DoC No.:** 00371-04-EU-02-02  
**Manufacturer's Name:** WOODWARD INC.  
**Manufacturer's Contact Address:** 1041 Woodward Way  
 Fort Collins, CO 80524 USA  
**Model Name(s)/Number(s):** Large Electric Sonic Valve with LELA Actuator  
 ASME B16.34 Class 300 and 600 flanges  
 LESV: 2, 3, 4 and 6 inch diameters  
 LESV II: 2 inch diameter  
**The object of the declaration described above is in conformity with the following relevant Union harmonization legislation:** **LELA Actuator portion of LESV:**  
 Directive 2014/34/EU of the European Parliament and of the Council of 26 February 2014 on the harmonization of the laws of the Member States relating to equipment and protective systems intended for use in potentially explosive atmospheres  
**Valve portion of LESV:**  
 Directive 2014/68/EU of the European Parliament and of the Council of 15 May 2014 on the harmonization of the laws of the Member States relating to the making available on the market of pressure equipment  
 2", 3", 4": PED Category II  
 6": PED Category III  
**For models with ID Module or Position Sensor:**  
 Directive 2014/30/EU of the European Parliament and of the Council of 26 February 2014 on the harmonization of the laws of the Member States relating to electromagnetic compatibility (EMC)  
**Markings in addition to CE marking:**   
**Applicable Standards:**  
**PED:** ASME Boiler and Pressure Vessel Code VIII, Div. 2, 2010  
**ATEX:** EN IEC 60079-0: 2018 Explosive Atmospheres - Part 0: Equipment – General Requirements  
 EN 60079-7:2015/A1: 2018 - Explosive Atmospheres – Part 7: Equipment protection by increased safety “e”  
**EMC:** EN 61000-6-4:2007/A1:2011 - Electromagnetic compatibility (EMC) - Part 6-4: Generic Standards – Emissions for Industrial Environments  
 EN 61000-6-2:2005 - Electromagnetic compatibility (EMC) - Part 6-2: Generic Standards – Immunity for Industrial Environments  
**Conformity Assessment:** PED Module H – Full Quality Assurance  
 CE-0062-PED-H-WDI 001-25-USA-rev-A Bureau Veritas SAS (0062)  
 4 Place des Saisons, 92400 COURBEVOIE, FRANCE

This declaration of conformity is issued under the sole responsibility of the manufacturer  
 We, the undersigned, hereby declare that the equipment specified above conforms to the above Directive(s).

MANUFACTURER

Signature

  
 Annette Lynch

Full Name

Engineering Manager

Position

Woodward, Fort Collins, CO, USA

Place

31 October 2025

Date

5-09-1183 Rev 43

**DECLARATION OF INCORPORATION  
Of Partly Completed Machinery  
2006/42/EC**

**File name:** 00371-04-EU-02-01  
**Manufacturer's Name:** WOODWARD INC.  
**Contact Address:** 1041 Woodward Way  
 Fort Collins, CO 80524 USA  
**Model Names:** Large Electric Sonic Valve (LESV, LESV II)  
 Sizes 2", 3", 4", and 6", Class 300 and 600

**This product complies, where applicable, with the following Essential Requirements of Annex I:** 1.1, 1.2, 1.3, 1.4, 1.5, 1.6, 1.7

---

The relevant technical documentation is compiled in accordance with part B of Annex VII. Woodward shall transmit relevant information if required by a reasoned request by the national authorities. The method of transmittal shall be agreed upon by the applicable parties.


The person authorized to compile the technical documentation:

**Name:** Dominik Kania, Managing Director  
**Address:** Woodward Poland Sp. z o.o., ul. Skarbowa 32, 32-005 Niepolomice, Poland

This product must not be put into service until the final machinery into which it is to be incorporated has been declared in conformity with the provisions of this Directive, where appropriate.

The undersigned hereby declares, on behalf of Woodward Inc. of Loveland and Fort Collins, Colorado that the above referenced product is in conformity with Directive 2006/42/EC as partly completed machinery:

**MANUFACTURER**

Signature	
Full Name	Annette Lynch
Position	Engineering Manager
Place	Woodward Inc., Fort Collins, CO, USA
Date	August 20, 2021

Document: 5-09-1182 (rev. 18)

We appreciate your comments about the content of our publications.

Send comments to: [industrial.support@woodward.com](mailto:industrial.support@woodward.com)

Please reference publication **26419**.



PO Box 1519, Fort Collins CO 80522-1519, USA  
1041 Woodward Way, Fort Collins CO 80524, USA  
Phone +1 (970) 482-5811

Email and Website—[www.woodward.com](http://www.woodward.com)

Woodward has company-owned plants, subsidiaries, and branches, as well as authorized distributors and other authorized service and sales facilities throughout the world.

Complete address / phone / fax / email information for all locations is available on our website.